

Atlas

# Heating and Cooling

Serena Peier, Rebecca Grobotek, Matteo Bianchi, and Linus Ham

Data centres are the invisible pillars of the cloud and are increasingly shaping the physical landscape. They produce enormous amounts of waste heat, the potential of which usually remains untapped. This dual role of places of intensive cooling that are also sources of energy, is examined in this research. Using the example of the data centres in Zurich Glattbrugg, it shows how technical systems, energy flows, and urban networks intertwine.

The work interrogates how data centers can evolve from isolated “fortresses” to open *forums*, becoming ecologically and socially integrated infrastructures where heat becomes visible and usable as a shared resource.


---

## Hot to Spot a Data Centre



DATA CENTER ZUR 2&3, DIGITAL REALTY GLATTBRUGG. Photograph: AOT, 2025.

You can (almost) always tell when you’re standing in front of a data centre. No windows, no openness, no trace of life: a box wrapped in perfectly brushed aluminium, gleaming like an oversized USB stick dropped in the middle of nowhere. Walk around it and you’ll begin to notice the signs: fences, cameras, and yellow border lines warning you off. Long silver pipes reach skyward: lifelines powered by diesel, ready to keep servers alive when the grid falters.

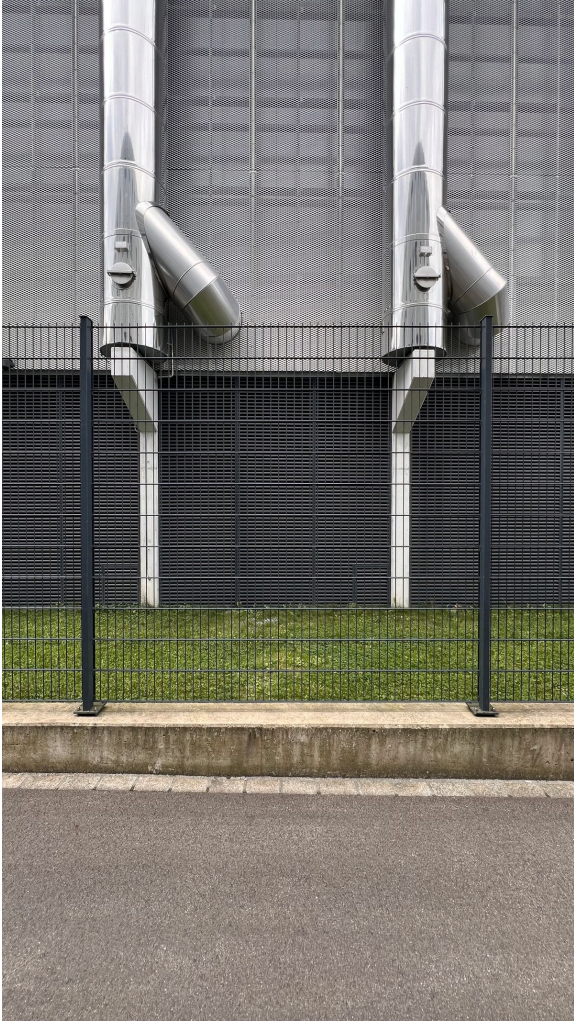

Fences



Cameras



Pipes



DATA CENTER ZUR 2 DIGITAL REALTY  
GLATTBRUGG. Photograph: AOT, 2025.



Cooling Infrastructure on the roof of  
the data center ZUR3, DigitalRealty  
Glattbrugg. Photograph: AOT, 2025.

Above, the rooftops pulse with an industrial rhythm; coolers, fans, and pipes forming a dense mechanical landscape that the aluminium facade below works so hard to disguise. From the sky, though, the truth becomes visible. Here, the most distinctive feature of a data centre stands out: the coolers.




Aerial view of DigitalRealty Campus in Glattbrugg. Photograph: map.geo.admin.ch, 2025.


In Glattbrugg, airplanes flying overhead have a perfect view of these rooftop chillers that mark the buildings unmistakably as data centres. Installing this equipment often happens at night, away from sight. More than 850 tons of machinery lifted under darkness, the work continuing while the city sleeps. At night, lit only by work lamps, the site resembles a tunnel, as if all the infrastructure was underground. Even test runs for the chimneys are done in the dark, when diesel engines exhale their dark smoke, quietly out of view. Seen this way, data centers are not really buildings in the conventional sense, they are infrastructure.




Transport of the chillers for installation on the roof. Screenshot from YouTube video by DigitalRealty Switzerland, 2024.

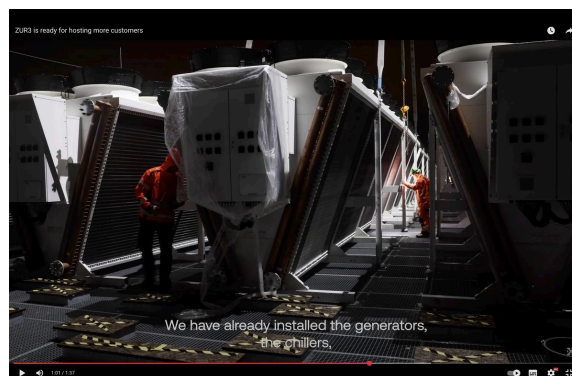

Installation of the chillers at night. Screenshot from YouTube video by DigitalRealty Switzerland, 2024.

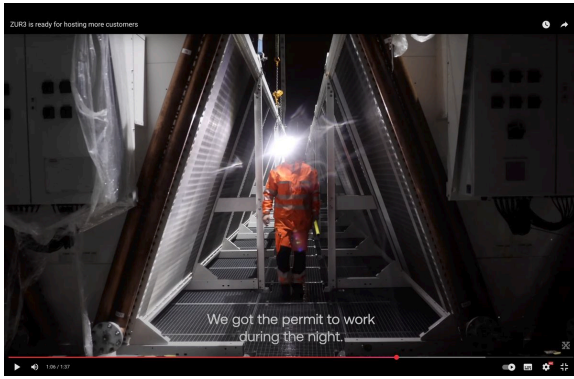

Installation of the chillers at night.  
Screenshot from YouTube video by DigitalRealty  
Switzerland, 2024.

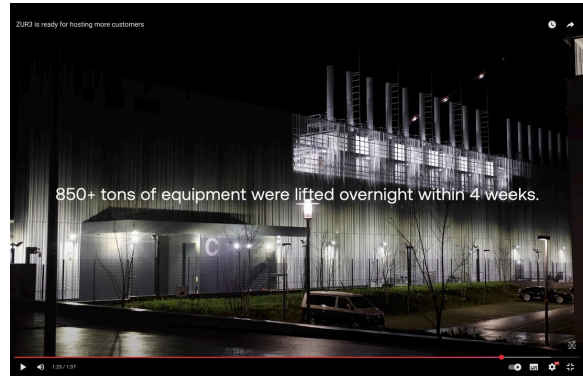


Installation of the chillers at night.  
Screenshot from YouTube video by DigitalRealty  
Switzerland, 2024.



DATA CENTER ZUR 2&3, DIGITAL REALTY GLATTBRUGG. Photograph: AOT, 2025.

You can (almost) always tell when you're standing in front of a data centre. No windows, no openness, no trace of life: a box wrapped in perfectly brushed aluminium, gleaming like an oversized USB stick dropped in the middle of nowhere. Walk around it and you'll begin to notice the signs: fences, cameras, and yellow border lines warning you off. Long silver pipes reach skyward: lifelines powered by diesel, ready to keep servers alive when the grid falters.

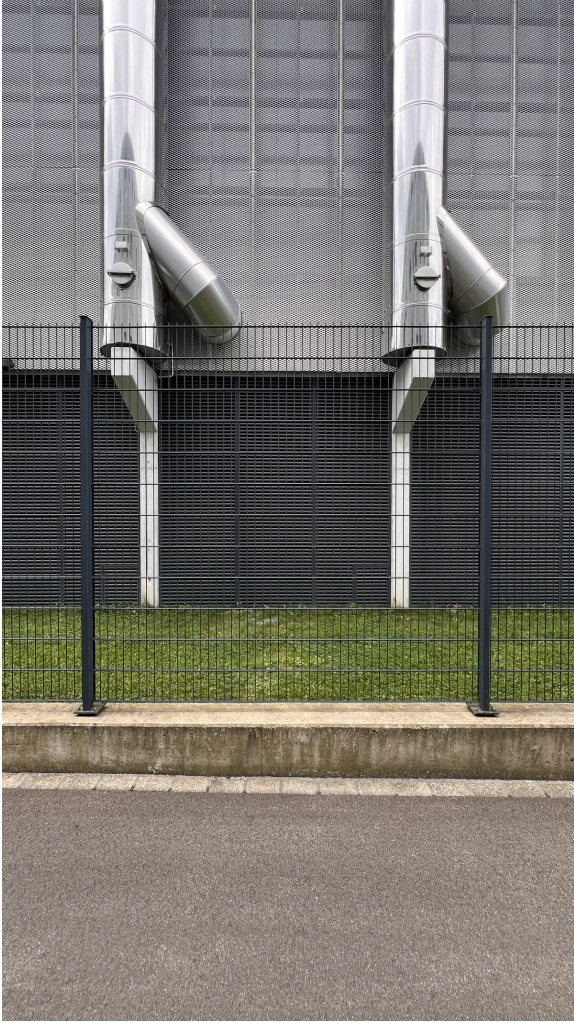

Fences



Cameras



Pipes



DATA CENTER ZUR 2 DIGITAL REALTY  
GLATTBRUGG. Photograph: AOT, 2025.




Cooling Infrastructure on the roof of  
the data center ZUR3, DigitalRealty  
Glattbrugg. Photograph: AOT, 2025.

Above, the rooftops pulse with an industrial rhythm; coolers, fans, and pipes forming a dense mechanical landscape that the aluminium facade below works so hard to disguise. From the sky, though, the truth becomes visible. Here, the most distinctive feature of a data centre stands out: the coolers.




Aerial view of DigitalRealty Campus in Glattbrugg. Photograph: map.geo.admin.ch, 2025.


In Glattbrugg, airplanes flying overhead have a perfect view of these rooftop chillers that mark the buildings unmistakably as data centres. Installing this equipment often happens at night, away from sight. More than 850 tons of machinery lifted under darkness, the work continuing while the city sleeps. At night, lit only by work lamps, the site resembles a tunnel, as if all the infrastructure was underground. Even test runs for the chimneys are done in the dark, when diesel engines exhale their dark smoke, quietly out of view. Seen this way, data centers are not really buildings in the conventional sense, they are infrastructure.

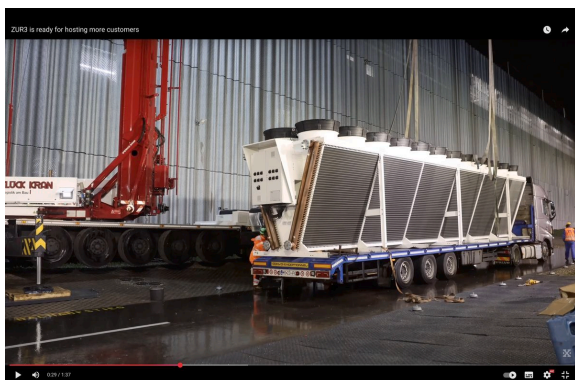


Transport of the chillers for installation on the roof. Screenshot from YouTube video by DigitalRealty Switzerland, 2024.

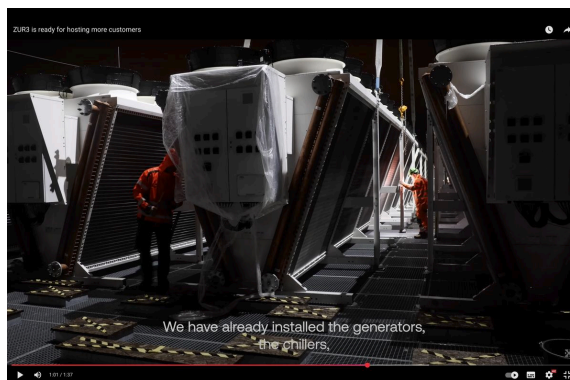

Installation of the chillers at night. Screenshot from YouTube video by DigitalRealty Switzerland, 2024.

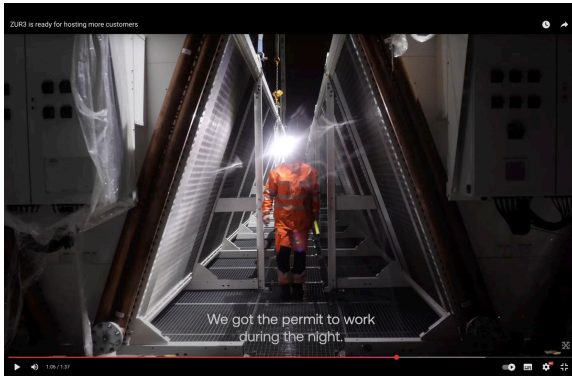

Installation of the chillers at night.  
Screenshot from YouTube video by DigitalRealty  
Switzerland, 2024.

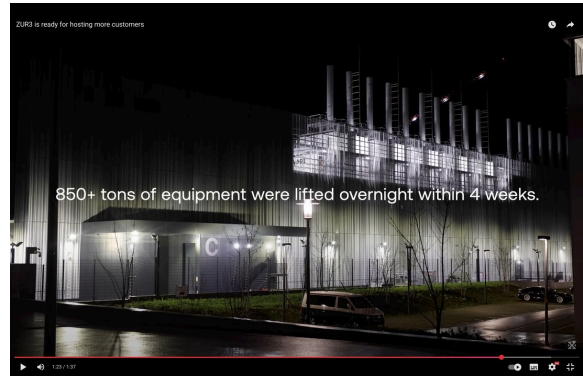

Installation of the chillers at night.  
Screenshot from YouTube video by DigitalRealty  
Switzerland, 2024.


## Cooling Infrastructure: Keeping the Cloud Alive

At first glance, the data center Blönduos in Iceland is barely distinguishable from any ordinary industrial facility. Its architectural camouflage is enhanced by a deliberate integration of the cooling infrastructure, which is largely concealed from exterior view. For the casual observer, the absence of visible cooling hardware suggests minimal thermal output.

Yet, when subjected to thermal imaging, the building's true nature is revealed. Even small data centres, such as this example, emit substantial quantities of waste heat, invisible to the eye but clearly mapped in infrared.




INCONSPICUOUS DATACENTER  
IN BLÖNDUOS, ICELAND  
Source: Invest in Iceland, 2023.

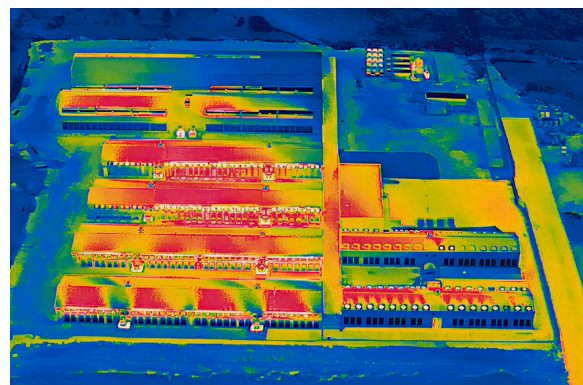


THERMAL IMAGE OF A DATACENTER  
IN BLÖNDUOS, ICELAND  
Source: YouTube "Just Icelandic," 2023.

The majority of this excess heat is dissipated through arrays of rooftop chillers: modular units that have become nearly emblematic of contemporary data centre design. Even for data centres of modest size, the arrangement and scale of chillers and piping illustrate the complexity required for reliable thermal regulation. Data centres commonly feature only two main archetypes of server racks, each with its advantages and disadvantages. Despite the apparent simplicity of rack layouts, the spectrum of cooling solutions adopted is extraordinarily varied, often scaling up to monumental proportions.

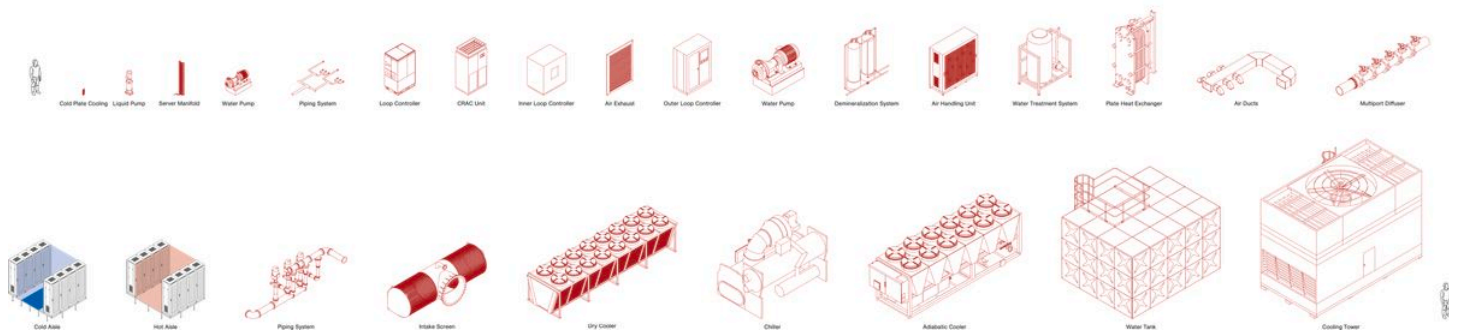

The choice of cooling system is intrinsically linked to climate. Mapping global climate zones alongside the most prevalent regional cooling methods illustrates a strong correlation between climatic conditions and cooling system selection, especially in Asia and Oceania.

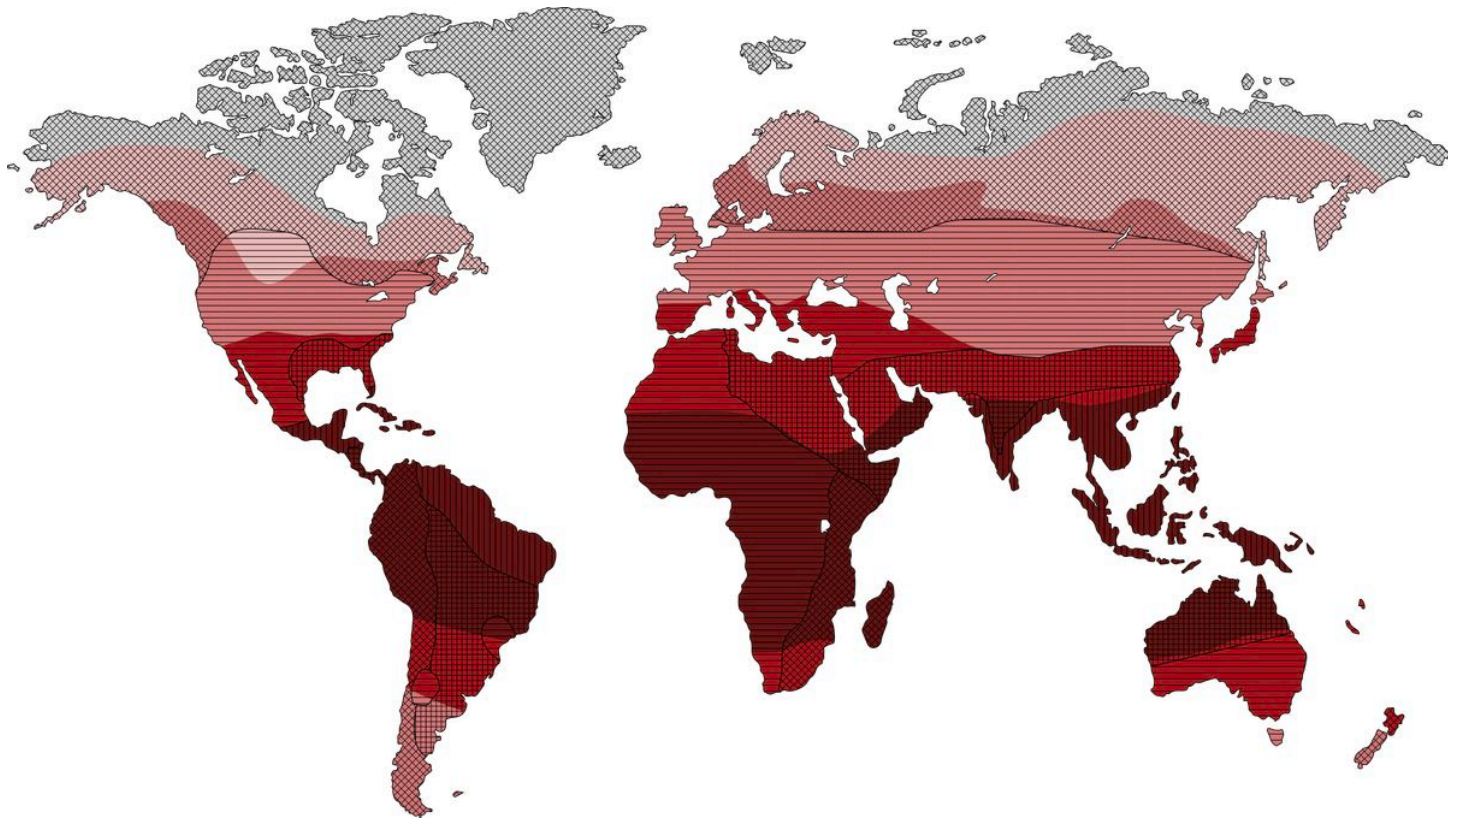


PREDOMINANT COOLING STRATEGY BY REGION

Source: Microsoft, 2023.

- |                  |                    |                                      |
|------------------|--------------------|--------------------------------------|
| ■ Polar zone     | ■ Subtropical Zone | ▨ Adiabatic Cooling                  |
| ■ Subpolar Zone  | ■ Tropical Zone    | ▨ Mechanical Cooling                 |
| ■ Temperate Zone | ▨ Free Air Cooling | ▨ High-efficiency Mechanical Cooling |

In subpolar climates, free air cooling is widely implemented and strongly promoted as highly sustainable, operationally efficient, and effective in reducing both energy and water consumption. The system leverages cold ambient air, particularly during extended seasons of low outdoor temperatures. This technique is frequently blended with adiabatic cooling in temperate regions to optimise efficiency during periods of fluctuating environmental conditions. Also the DigitalRealty data center in Glattbrugg, Switzerland, uses for much of the year free air cooling suffices, with ambient air itself serving as the primary medium for heat exchange. The inner cooling circuit and outer circuits remain isolated, preserving efficiency and operational safety.

In almost all setups, plate heat exchangers act as mediators between circuits, enabling heat transfer without direct mixing of fluids. Their repeated appearance in schematics and technical photographs is a testament to their ubiquity within advanced data centre engineering. The potential for sustainable energy redistribution is exemplified by the role of plate heat exchangers in waste heat recovery. These devices facilitate the transfer of thermal energy from data centre cooling loops to external consumers such as local housing cooperatives or district heating networks. Such repurposing of byproduct heat represents a promising avenue for urban energy synergies and reduced overall carbon footprint.

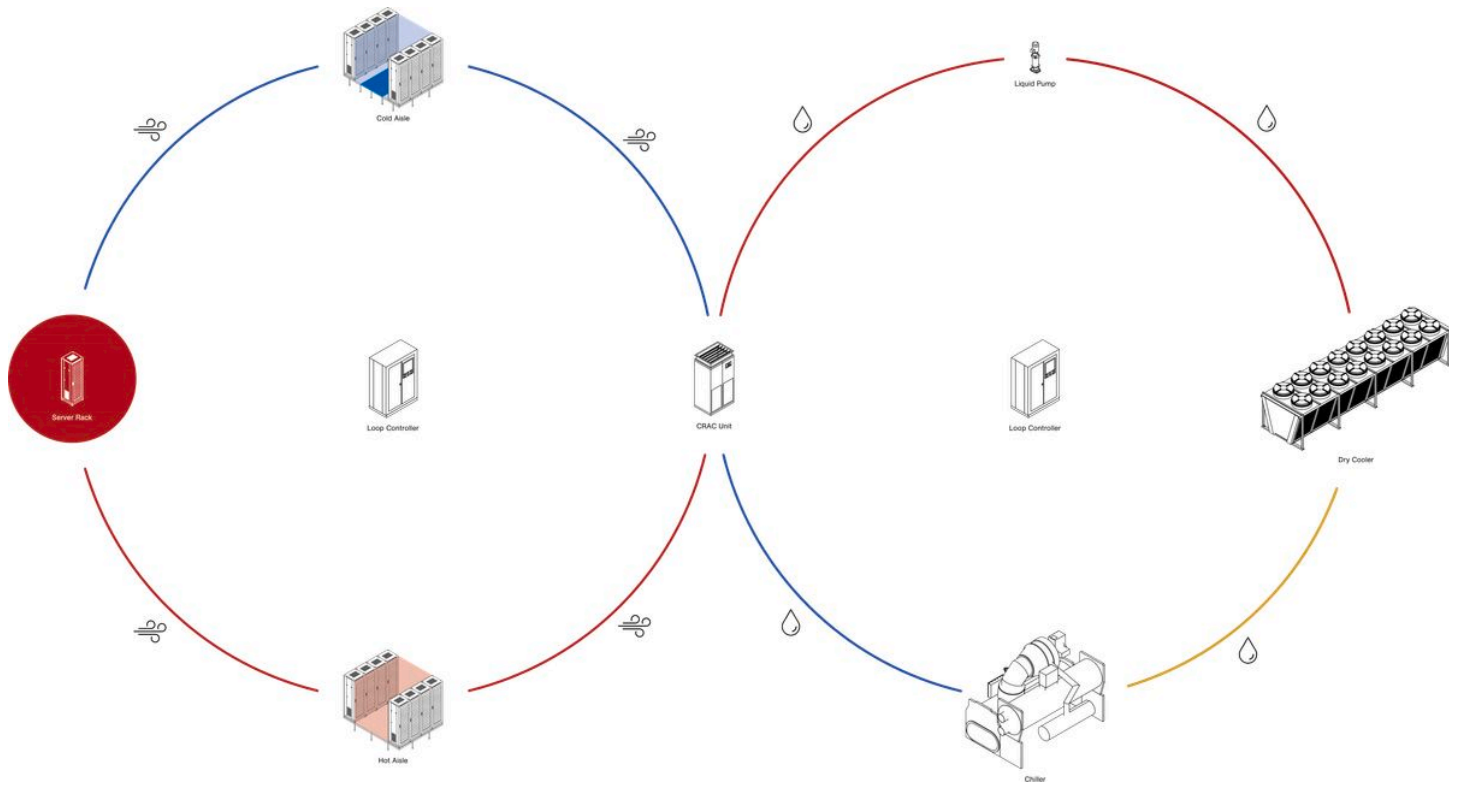


FREE AIR COOLING SYSTEM

Hot server air is cooled in CRAC units and recirculated to the servers. The Warm coolant is sent to dry coolers for outside air cooling; if external temperatures are high, it is additionally cooled by a chiller before returning to the CRAC.

■ hot  
■ warm

■ cold  
💧 liquid

🌀 air

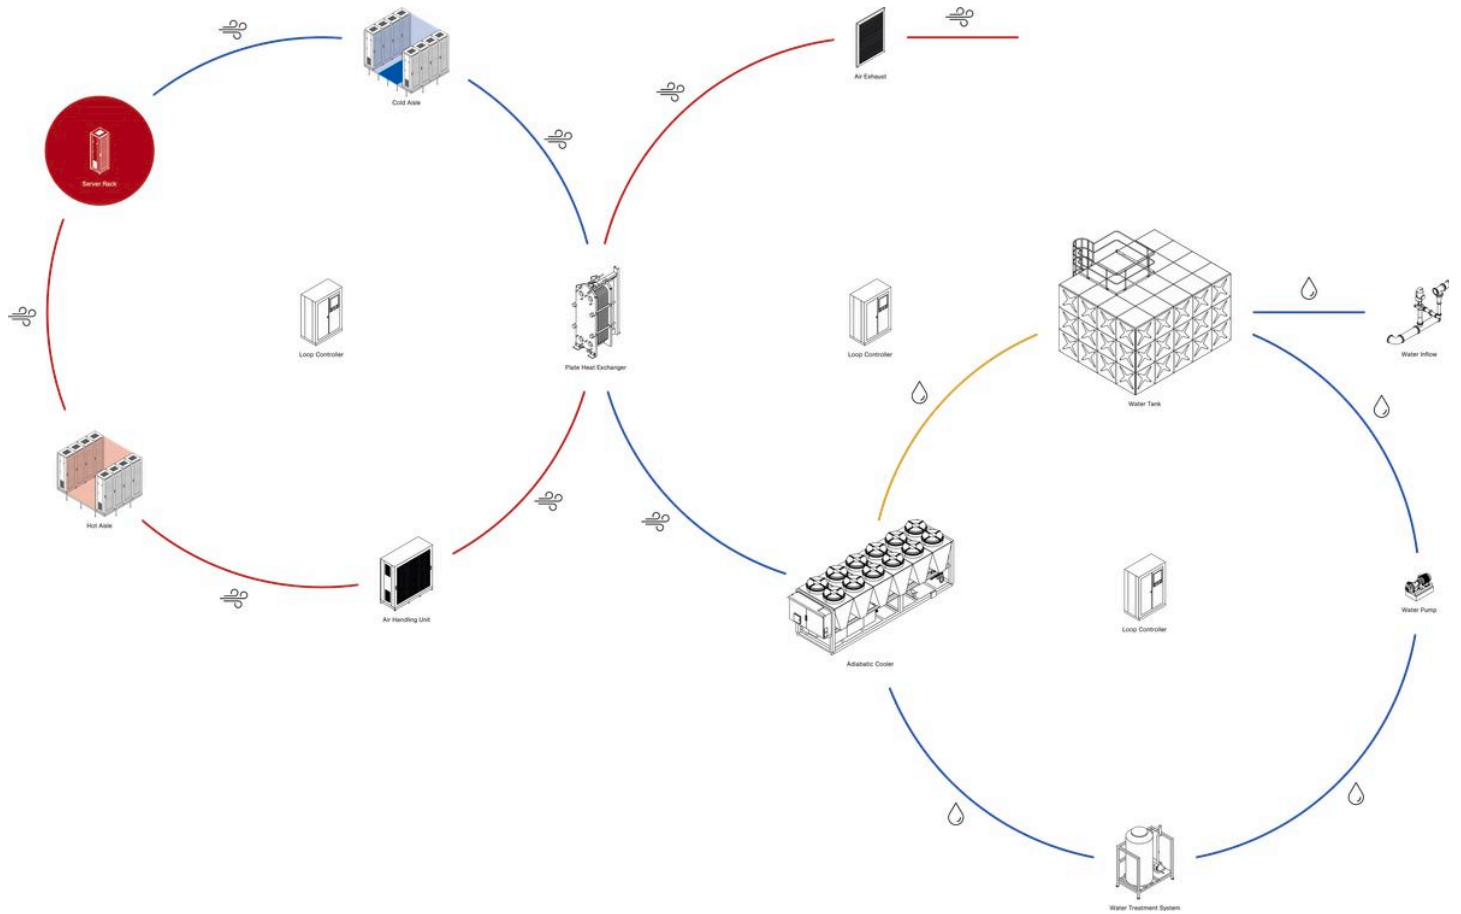


### ADIABATIC COOLING SYSTEM

Hot server air is extracted by air handling units and passed through a plate heat exchanger, where it is cooled by outside air. The cooled air returns to the servers. The cold air in the heat exchanger is supplied by an adiabatic cooler, which cools outside air via water evaporation. Exhaust air from the heat exchanger is released outside.

■ hot  
■ warm

■ cold  
💧 liquid


☞ air

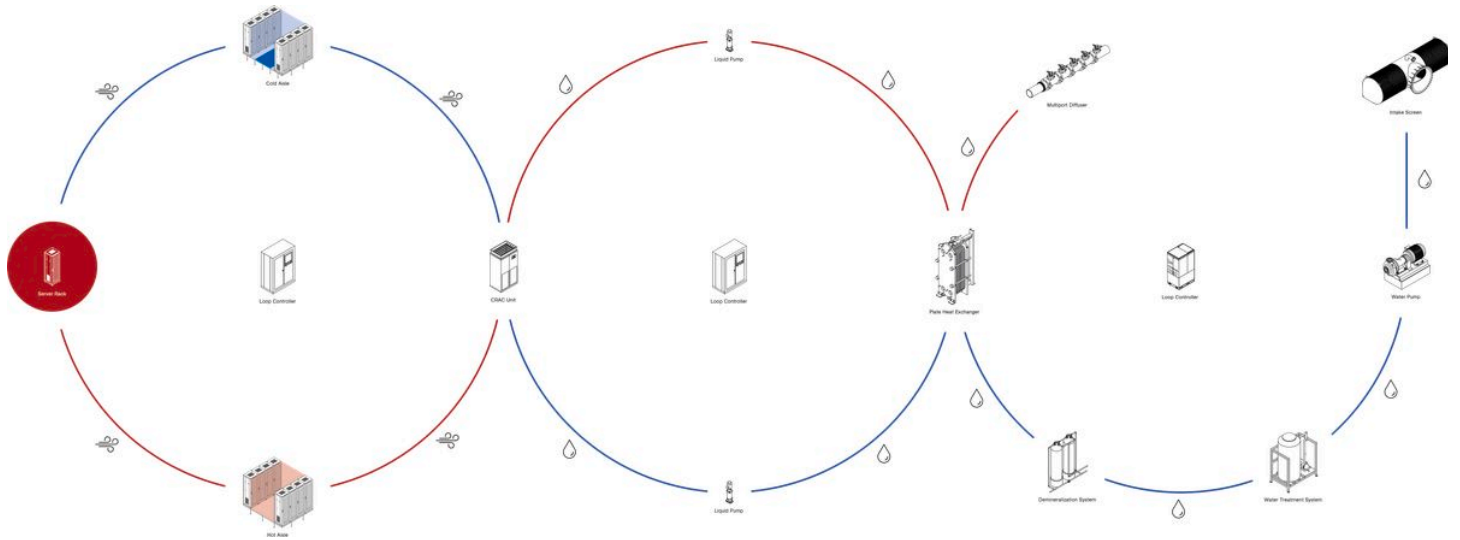

**RIVER-/LAKEWATER COOLING SYSTEM**

Hot server air is cooled by CRAC units. The CRAC coolant is chilled using liquid-to-liquid plate heat exchangers. The cool water for these exchangers comes directly from a lake or river and is cleaned by filtration and sediment processes. Warm water exiting the heat exchangers is returned to the lake.


- hot
- cold
- liquid
- ✂ air

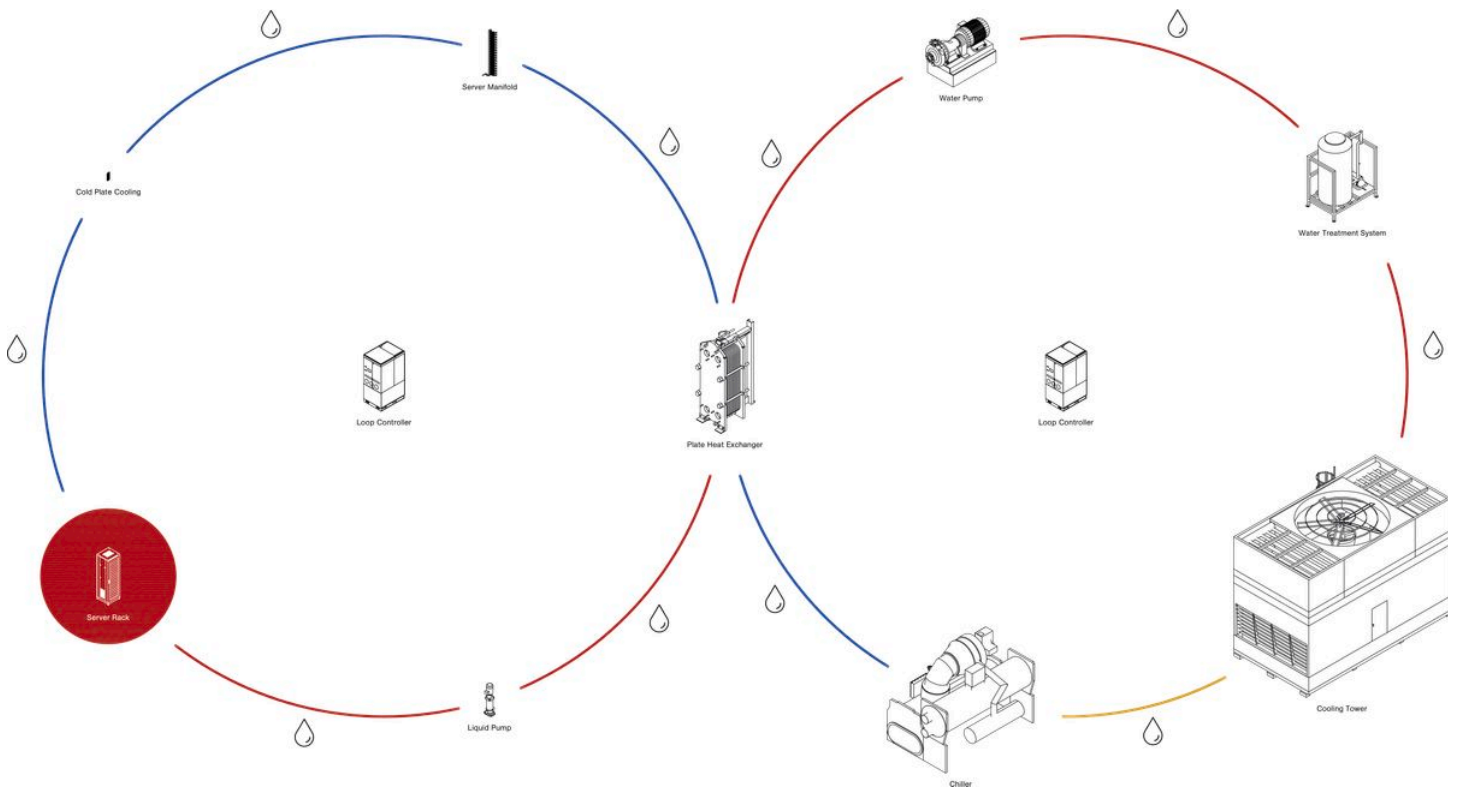

**LIQUID COOLING SYSTEM**

Servers are cooled directly by liquid. Hot liquid from the servers flows into a liquid-to-liquid plate heat exchanger, where it is cooled and then recirculated back to the servers. The cold liquid for the plate heat exchanger is chilled by circulating through cooling towers and chillers.

- hot
- cold
- warm
- liquid

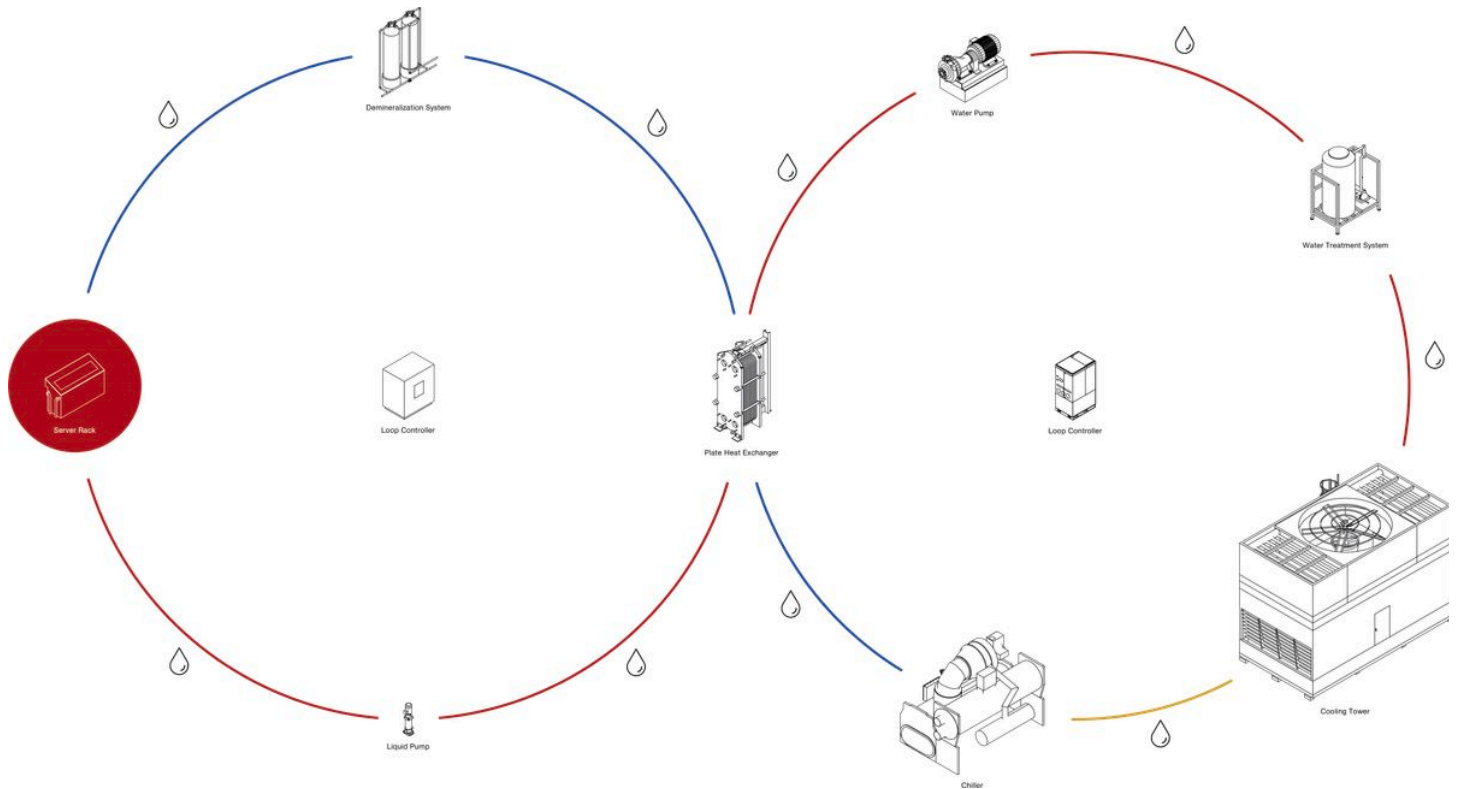

### IMMERSION COOLING SYSTEM

Servers are submerged in a coolant bath. The liquid is often cleaned and demineralised. Hot coolant is cooled in a plate heat exchanger and then circulated back to the cooling tank. The cold liquid for the plate heat exchanger is chilled by circulating through cooling towers and chillers.


- hot
- cold
- warm
- liquid

At first glance, the data center Blönduós in Iceland is barely distinguishable from any ordinary industrial facility. Its architectural camouflage is enhanced by a deliberate integration of the cooling infrastructure, which is largely concealed from exterior view. For the casual observer, the absence of visible cooling hardware suggests minimal thermal output.

Yet, when subjected to thermal imaging, the building's true nature is revealed. Even small data centres, such as this example, emit substantial quantities of waste heat, invisible to the eye but clearly mapped in infrared.




INCONSPICUOUS DATACENTER  
IN BLÖNDUÓS, ICELAND  
Source: Invest in Iceland, 2023.

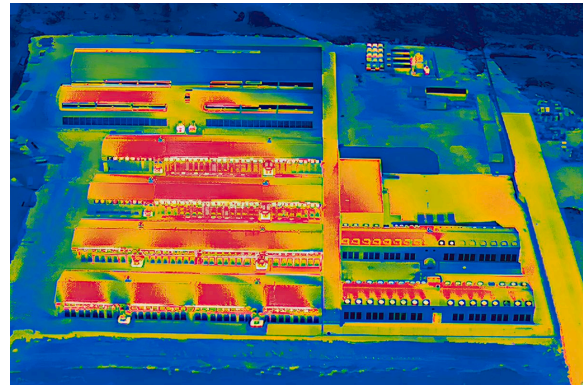


THERMAL IMAGE OF A DATACENTER  
IN BLÖNDUÓS, ICELAND  
Source: YouTube "Just Icelandic," 2023.

The majority of this excess heat is dissipated through arrays of rooftop chillers: modular units that have become nearly emblematic of contemporary data centre design. Even for data centres of modest size, the arrangement and scale of chillers and piping illustrate the complexity required for reliable thermal regulation. Data centres commonly feature only two main archetypes of server racks, each with its advantages and disadvantages. Despite the apparent simplicity of rack layouts, the spectrum of cooling solutions adopted is extraordinarily varied, often scaling up to monumental proportions.

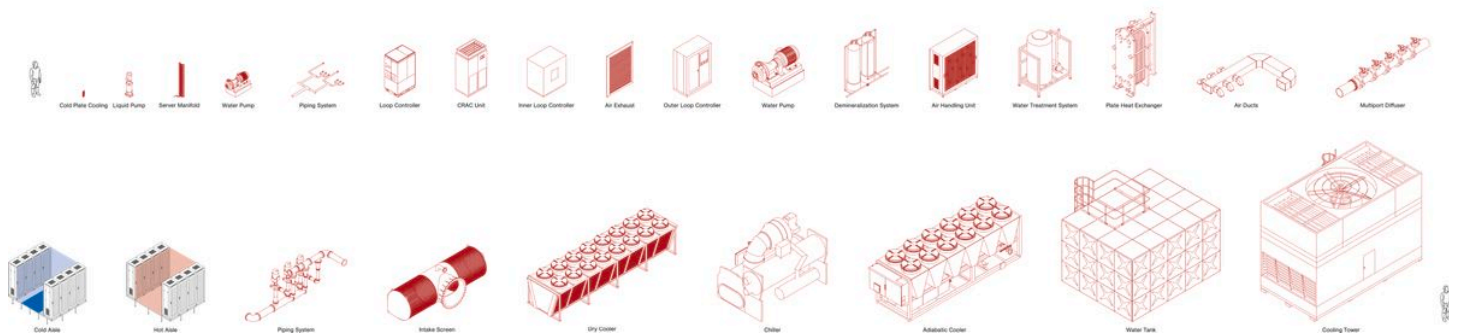

The choice of cooling system is intrinsically linked to climate. Mapping global climate zones alongside the most prevalent regional cooling methods illustrates a strong correlation between climatic conditions and cooling system selection, especially in Asia and Oceania.

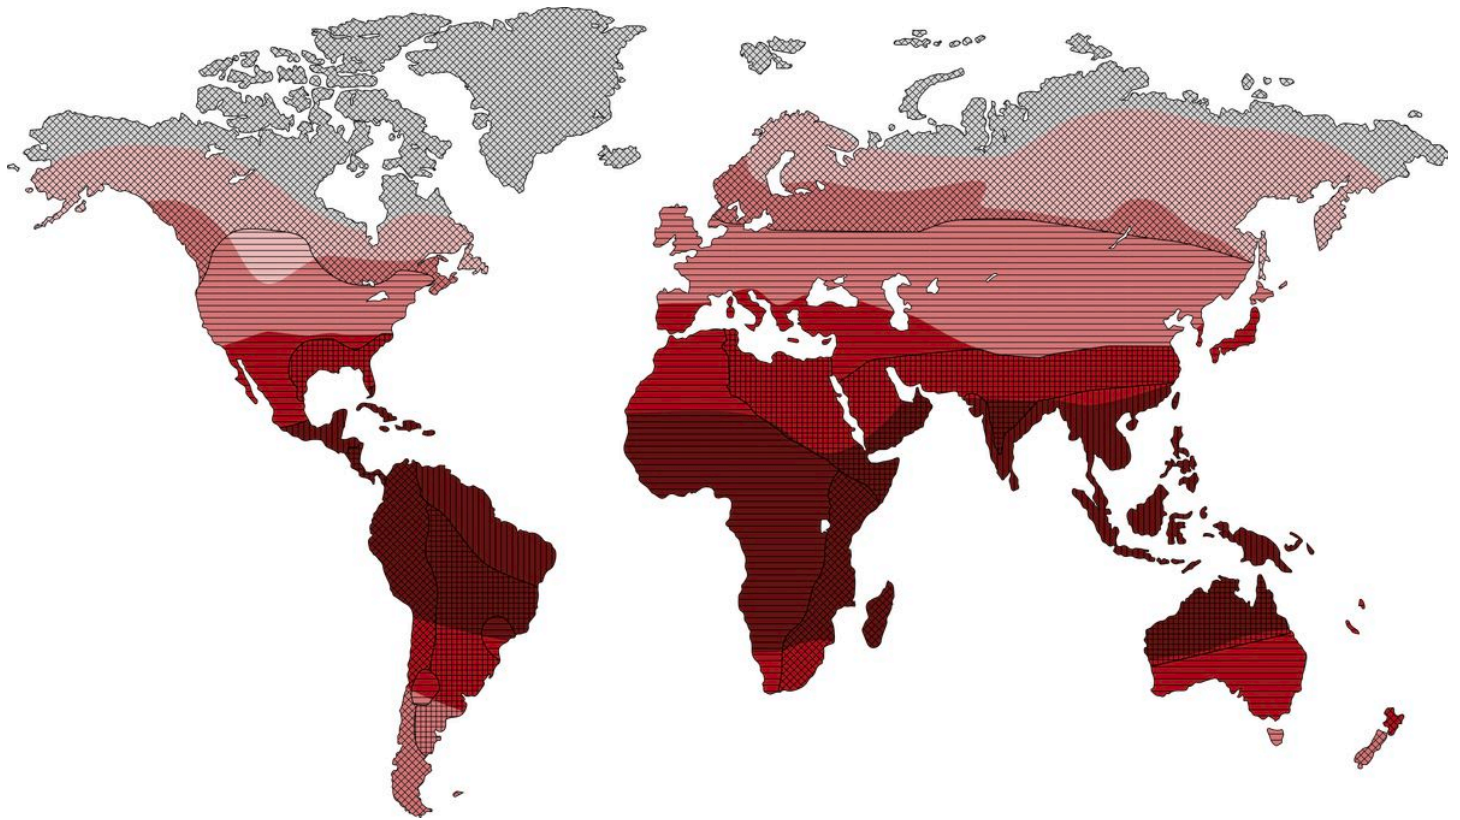


PREDOMINANT COOLING STRATEGY BY REGION

Source: Microsoft, 2023.

- |   |   |   |
|---|---|---|
| <span style="display:inline-block; width:15px; height:15px; background-color:grey; border:1px solid black;"></span> Polar zone          | <span style="display:inline-block; width:15px; height:15px; background-color:darkred; border:1px solid black;"></span> Subtropical Zone | <span style="display:inline-block; width:15px; height:15px; border:1px solid black; border-style:dashed;"></span> Adiabatic Cooling   |
| <span style="display:inline-block; width:15px; height:15px; background-color:lightcoral; border:1px solid black;"></span> Subpolar Zone | <span style="display:inline-block; width:15px; height:15px; background-color:firebrick; border:1px solid black;"></span> Tropical Zone  | <span style="display:inline-block; width:15px; height:15px; border:1px solid black; border-style:dotted;"></span> Mechanical Cooling  |
| <span style="display:inline-block; width:15px; height:15px; background-color:coral; border:1px solid black;"></span> Temperate Zone     | <span style="display:inline-block; width:15px; height:15px; border:1px solid black; border-style:double;"></span> Free Air Cooling      | <span style="display:inline-block; width:15px; height:15px; border:1px solid black; border-style:double; border-image: linear-gradient(to right, transparent 49%, black 49% 51%, black 51% 53%, transparent 53%) 1 1;"></span> High-efficiency Mechanical Cooling |

In subpolar climates, free air cooling is widely implemented and strongly promoted as highly sustainable, operationally efficient, and effective in reducing both energy and water consumption. The system leverages cold ambient air, particularly during extended seasons of low outdoor temperatures. This technique is frequently blended with adiabatic cooling in temperate regions to optimise efficiency during periods of fluctuating environmental conditions. Also the DigitalRealty data center in Glattbrugg, Switzerland, uses for much of the year free air cooling suffices, with ambient air itself serving as the primary medium for heat exchange. The inner cooling circuit and outer circuits remain isolated, preserving efficiency and operational safety.

In almost all setups, plate heat exchangers act as mediators between circuits, enabling heat transfer without direct mixing of fluids. Their repeated appearance in schematics and technical photographs is a testament to their ubiquity within advanced data centre engineering. The potential for sustainable energy redistribution is exemplified by the role of plate heat exchangers in waste heat recovery. These devices facilitate the transfer of thermal energy from data centre cooling loops to external consumers such as local housing cooperatives or district heating networks. Such repurposing of byproduct heat represents a promising avenue for urban energy synergies and reduced overall carbon footprint.

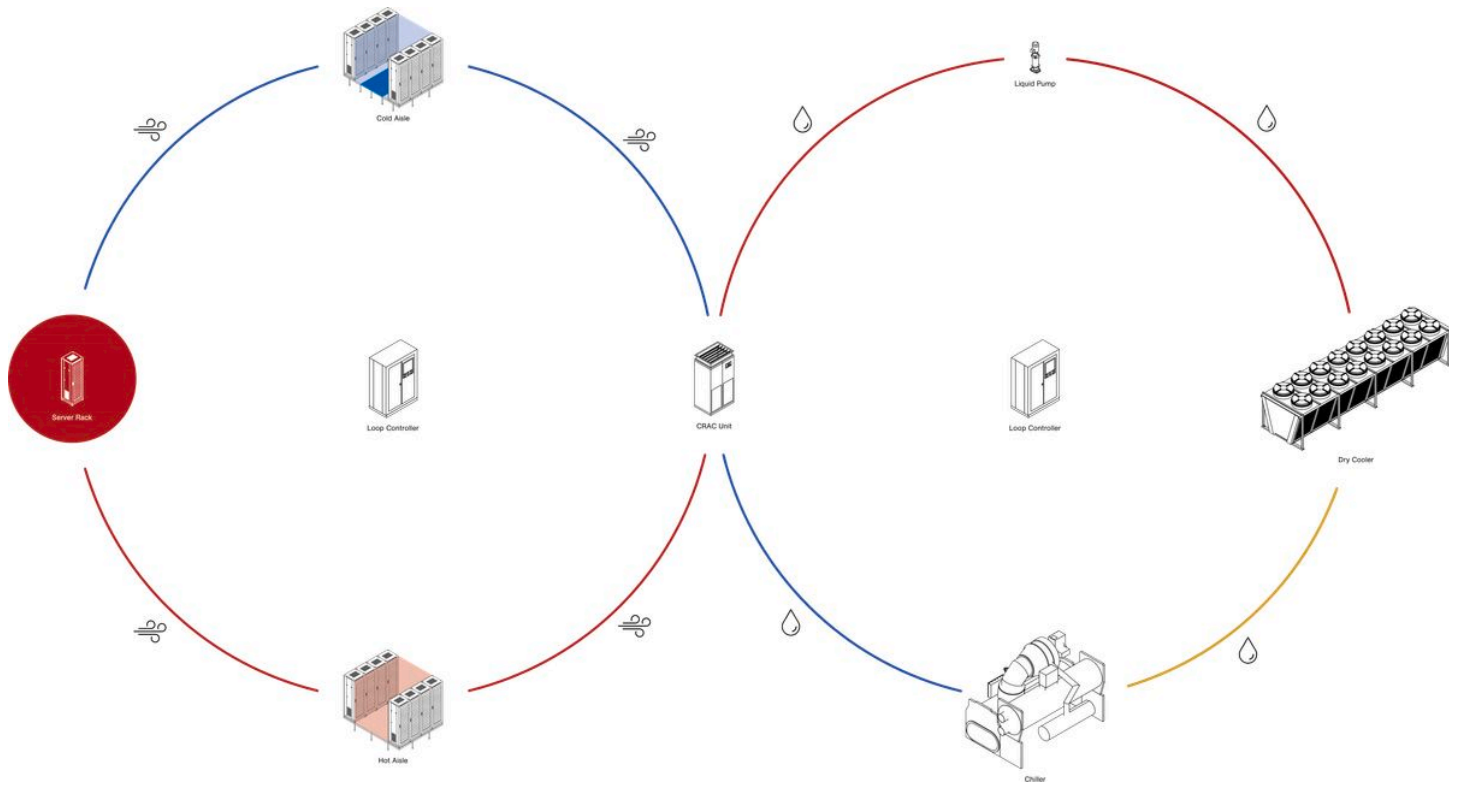


### FREE AIR COOLING SYSTEM

Hot server air is cooled in CRAC units and recirculated to the servers. The Warm coolant is sent to dry coolers for outside air cooling; if external temperatures are high, it is additionally cooled by a chiller before returning to the CRAC.

■ hot  
■ warm

■ cold  
💧 liquid

☹ air

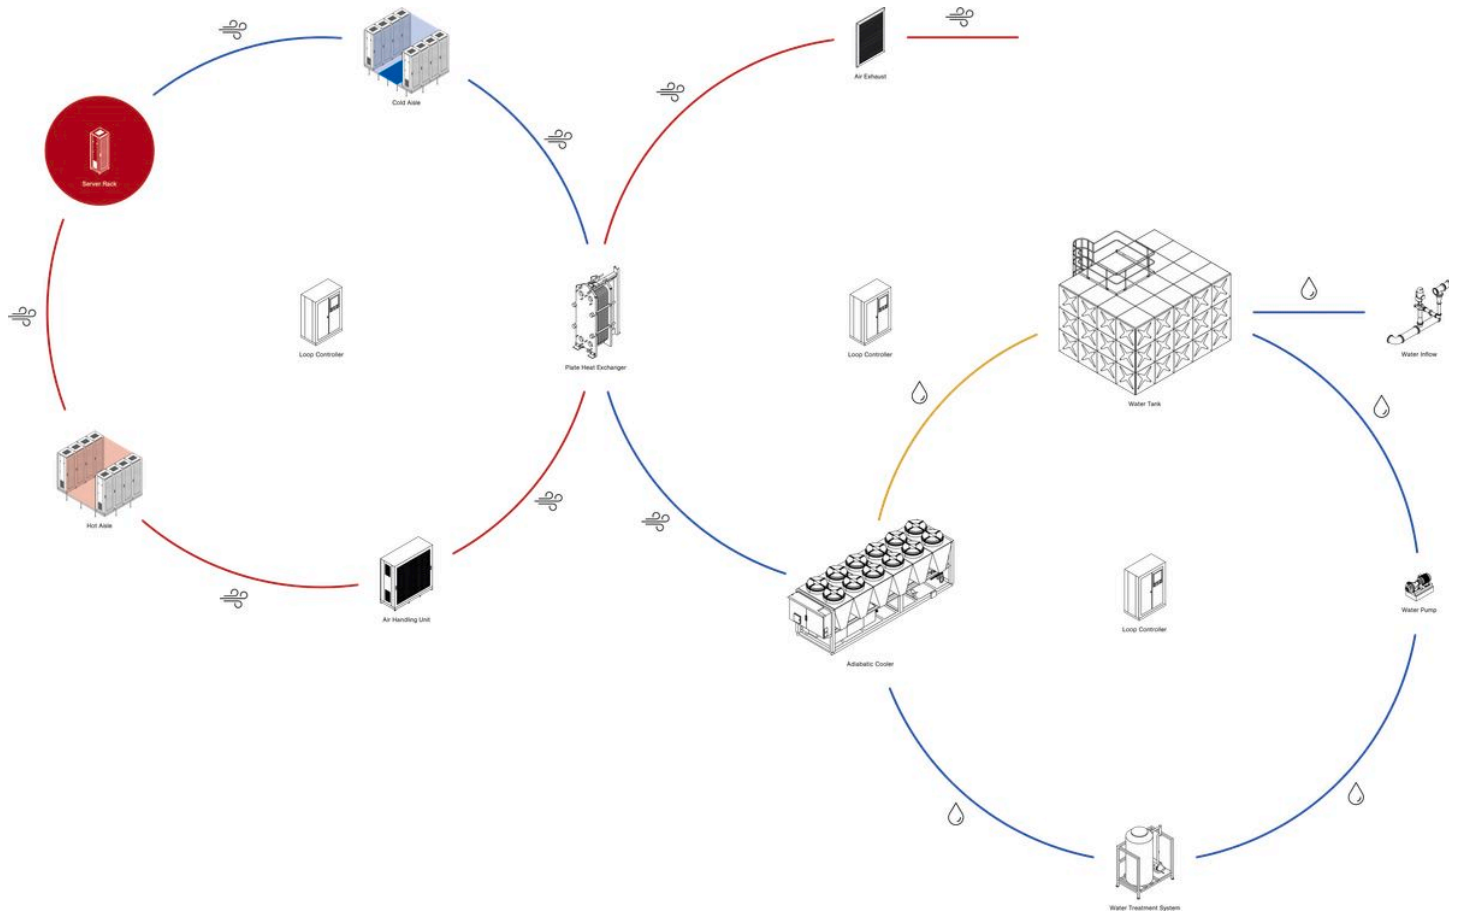


ADIABATIC COOLING SYSTEM

Hot server air is extracted by air handling units and passed through a plate heat exchanger, where it is cooled by outside air. The cooled air returns to the servers. The cold air in the heat exchanger is supplied by an adiabatic cooler, which cools outside air via water evaporation. Exhaust air from the heat exchanger is released outside.

■ hot  
■ warm

■ cold  
💧 liquid


✂ air

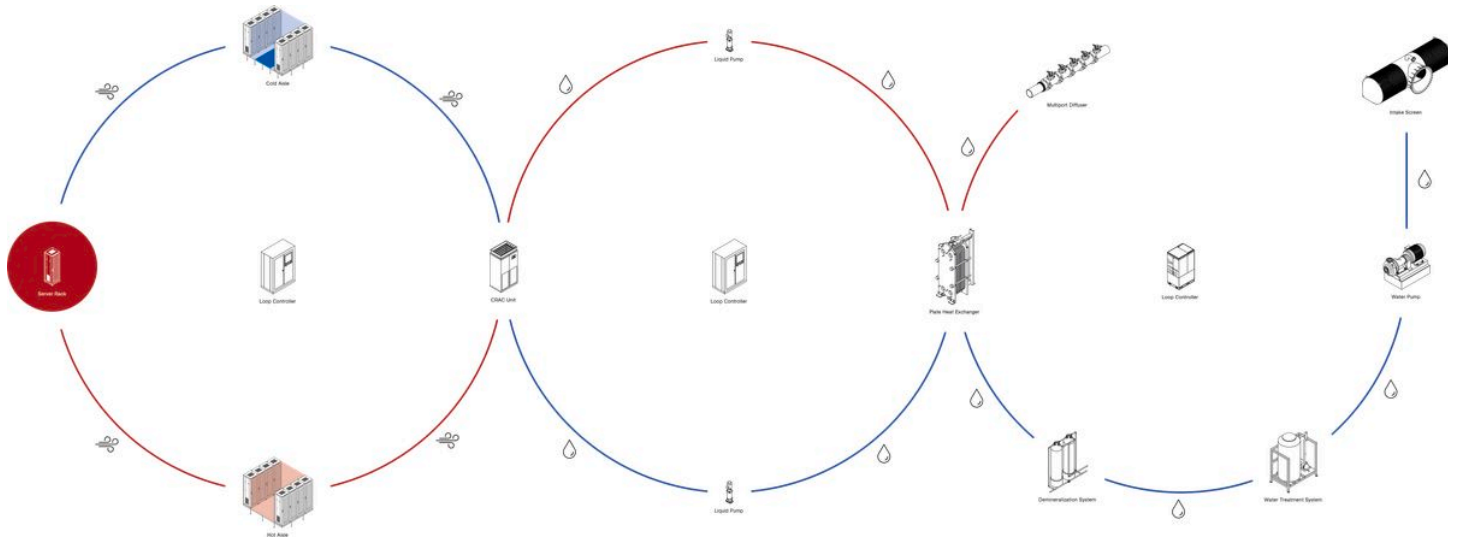

### RIVER-/LAKEWATER COOLING SYSTEM

Hot server air is cooled by CRAC units. The CRAC coolant is chilled using liquid-to-liquid plate heat exchangers. The cool water for these exchangers comes directly from a lake or river and is cleaned by filtration and sediment processes. Warm water exiting the heat exchangers is returned to the lake.


- hot
- cold
- liquid
- ✂ air

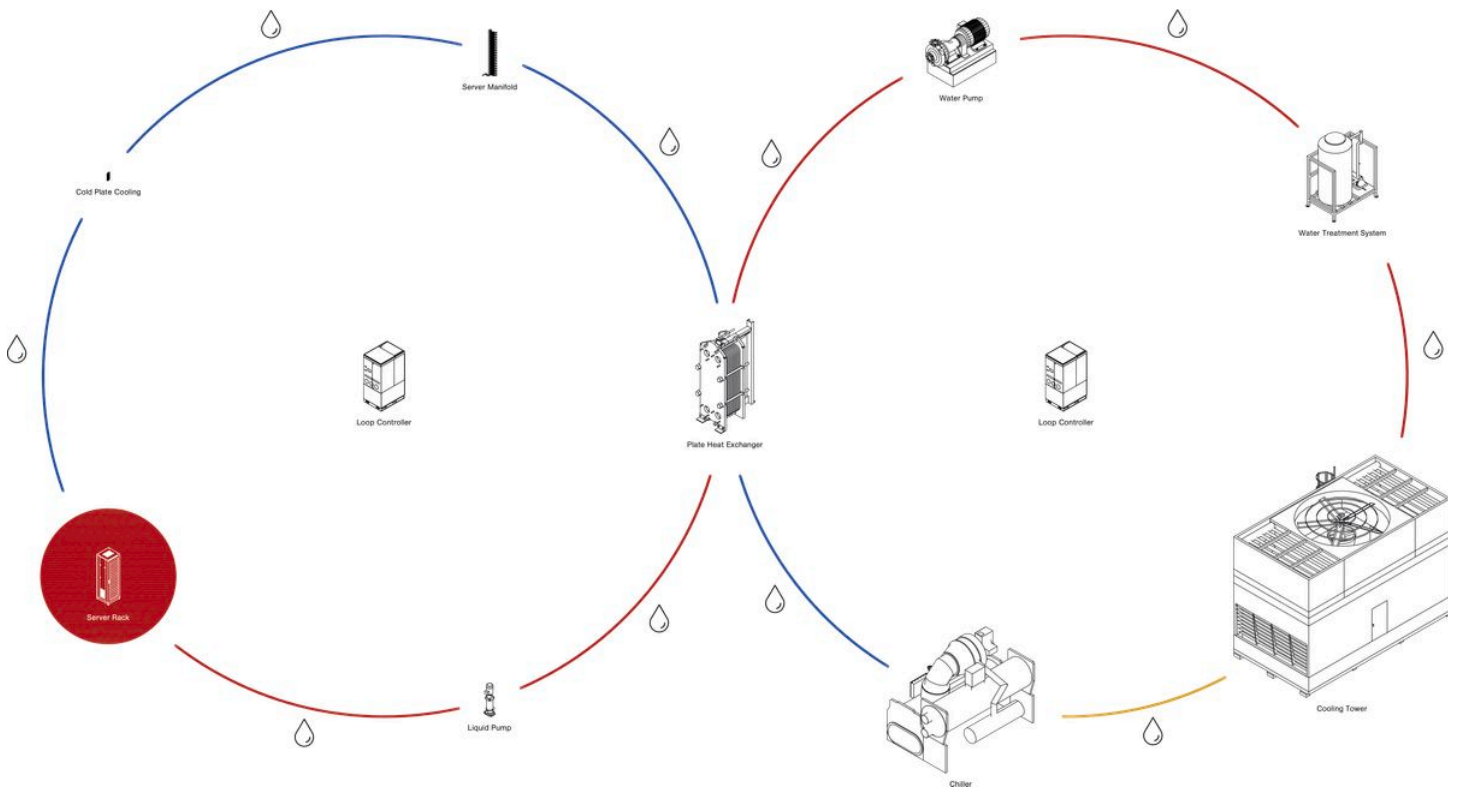

### LIQUID COOLING SYSTEM

Servers are cooled directly by liquid. Hot liquid from the servers flows into a liquid-to-liquid plate heat exchanger, where it is cooled and then recirculated back to the servers. The cold liquid for the plate heat exchanger is chilled by circulating through cooling towers and chillers.

- hot
- cold
- warm
- liquid

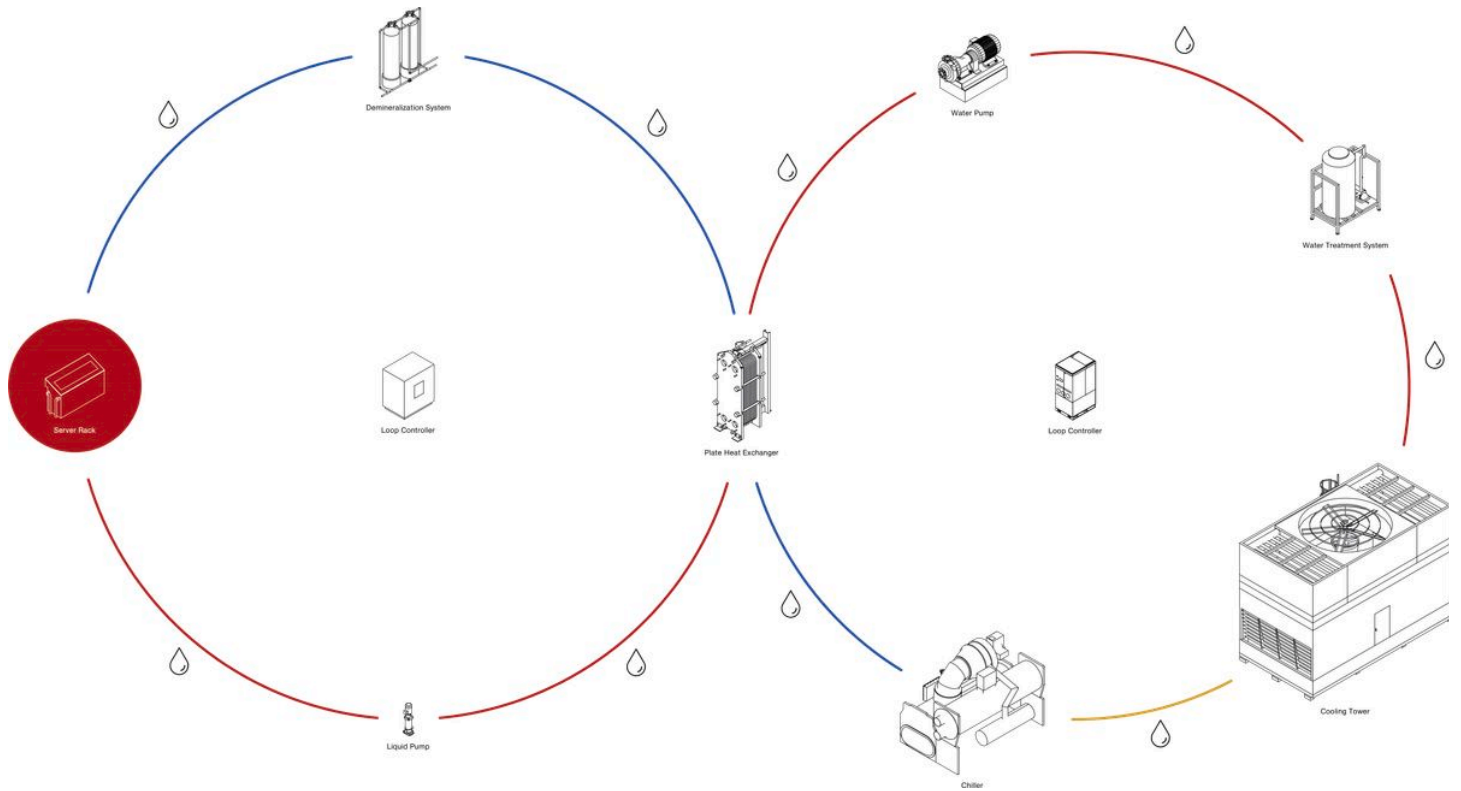


### IMMERSION COOLING SYSTEM

Servers are submerged in a coolant bath. The liquid is often cleaned and demineralised. Hot coolant is cooled in a plate heat exchanger and then circulated back to the cooling tank. The cold liquid for the plate heat exchanger is chilled by circulating through cooling towers and chillers.

- hot  
■ warm
- cold  
● liquid

# Heat as a Resource

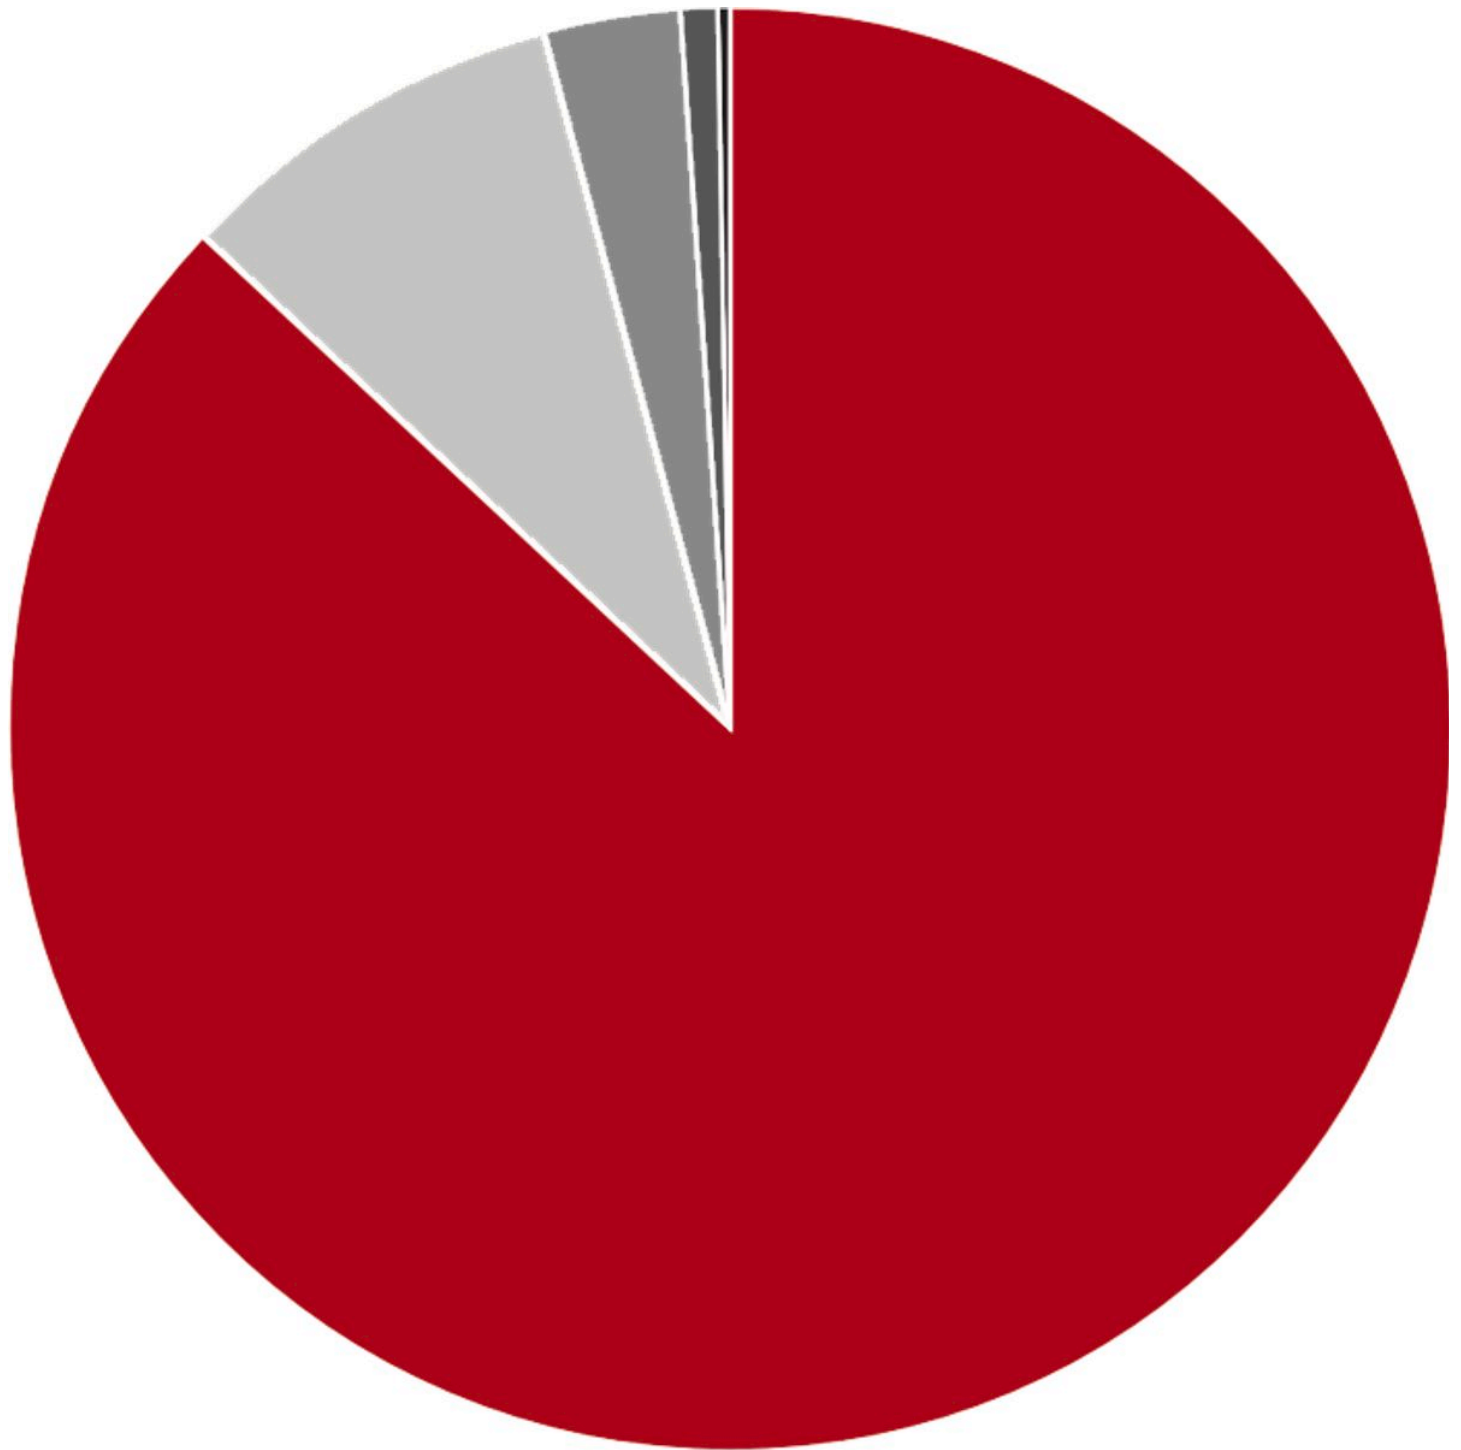

A 45 MW DATACENTER HAS A HEAT OUTPUT OF 51'694'500 WATT

0.01% people  
1% lighting


2.9% power distribution  
9% UPS with battery

87% IT-equipment

The magnitude of waste heat produced by a typical data centre is often underestimated. Consider a facility with a computational capacity of 45 megawatt (MW): the combined power of the three data centres of Digital Realty in Glattbrugg. Such a center generates approximately 51.5 MW of thermal energy as waste heat. If recovered with perfect efficiency, this output could supply the entire thermal energy demand (for residential and non-residential uses) in Zürich's Altstetten district. Alternatively, the same quantity of heat could operate 70 public swimming pools. Or if converted entirely to electrical energy, enable 18.8 InterCity train journeys from Zurich to Bern every hour. These comparisons illustrate not only the extraordinary energy density inherent in data centre operations, but also their potential for contributing positively to broader urban infrastructure.



WASTE HEAT COVERS THE THERMAL ENERGY DEMAND OF ALTSTETTEN (ZH)

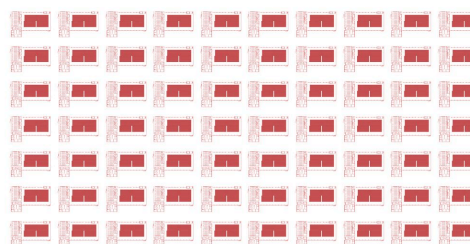


WASTE HEAT COVERS THE THERMAL ENERGY DEMAND OF 70 PUBLIC SWIMMING POOLS

Source: Energie Schweiz, 2024.



WASTE HEAT COVERS THE ENERGY FOR 18.8 INTERCITY TRIPS ZURICH - BERN PER HOUR

## WASTE HEAT POTENTIAL

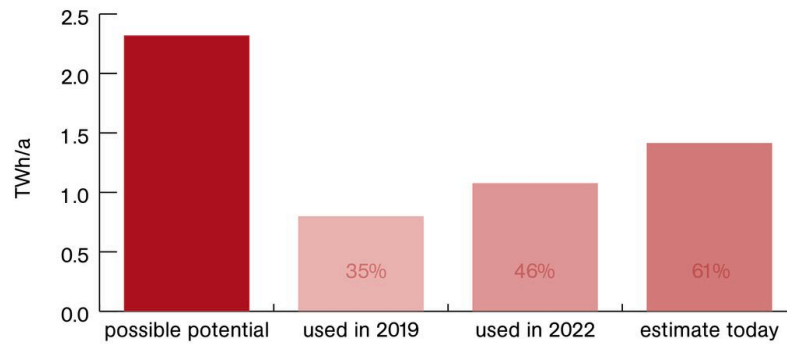


Waste heat potential of data centres in Switzerland. Source: EnergieSchweiz, 2023.

The realistic waste heat potential from data centers in Switzerland is between 2.02 and 2.62 terawatt hour per year (TWh/a) (median 2.32 TWh). In 2019, 35 % of data centres utilised this waste heat. By 2022, 46 % did, with another 15 % planning to do so. This gives a mid-term usage potential of 46–61 %. This waste heat could provide heating and hot water to 140,000–185,000 households (3.7–4.7 % of all Swiss homes), saving 420,000–555,000 tonnes of CO<sub>2</sub> per year by replacing fossil heating. Unlike other industries, data centres produce waste heat at a constant, reliable rate, year-round, 8,760 hours per year, making them secure sources for heating networks.

## ENERGY NETWORK AIRPORT CITY



Map of the perimeter of the Airport City energy network. Source: EBL, 2022.

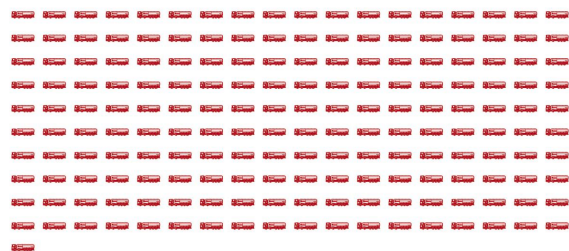

5.6 million liters of heating oil equal 181 large tank trucks with a capacity of approximately 31,000 liters each.

In projects like the Airport City Energy Network near Zurich Airport, operators aim to recycle the warmth produced by Digital Realty's facilities. Doing so could save 15,000 tons of CO<sub>2</sub> annually, the equivalent of 5.6 million liters of heating oil.


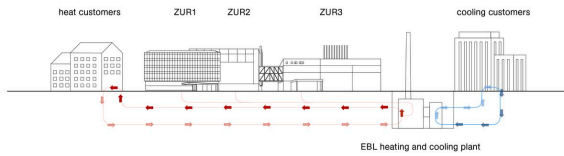



Diagram showing how the "Energieverbund" could work.

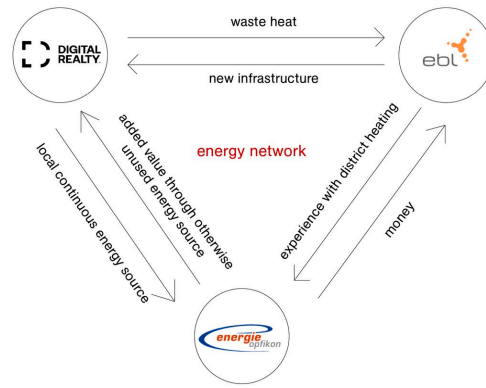


Players involved in planning the "Energieverbund" of the Airport City.

In a high-temperature waste heat network, the waste heat is usually extracted at a temperature level between 20°C and 30°C and then raised to the required level of 65°C–80°C using a heat pump. This allows even low-temperature waste heat from data centres to be used while still supplying areas that require higher temperatures (e.g., older buildings). The downside is higher investment costs and reduced energy efficiency due to the heat pump. After, it is distributed to customers through a network of pipes for heating, hot water production, or cooling. The goal is to use local energy more sustainably and reduce CO<sub>2</sub> emissions.

The three main players are DigitalRealty, which would supply the waste heat; EBL, which brings experience with district heating networks; and Energie Opfikon AG, responsible for providing the city with water and electricity.

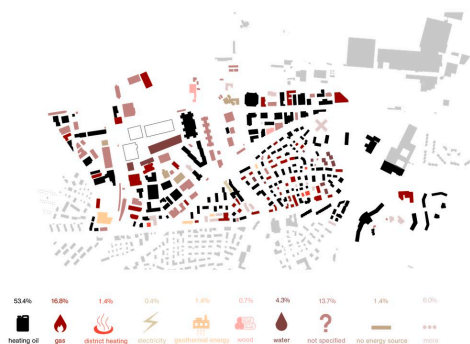

The current energy sources of the buildings within the potential perimeter of the energy network.

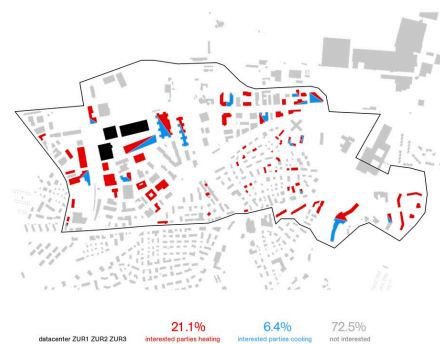

The Airport City perimeter and its possible interested parties in waste heat and cold.



Potentially interested parties in heat and cold supply in the perimeter of the energy network and their current energy sources.

Compared to the current energy sources within the energy network, about 70 % comes from heating with oil and gas, which are fossil fuels that should be avoided whenever possible.


Looking at the map of potential waste heat recipients, it quickly becomes apparent that only a small number of buildings are affected; about one-third of the possible consumers within the energy network. This is even more surprising given that the potential waste heat from the data centres is actually much greater than the total heat demand of the entire network. Comparing these two maps, it becomes clear that primarily oil-fired boilers would be replaced, which would be a step toward renewable energy. However, looking at the grey areas, which show buildings not interested in connecting to the district heating network, there is a large amount of untapped potential. But why is this the case? Are there alternative energy sources that are more attractive? Or are the costs and associated risks too high?

The idea of an energy network has currently been put on hold because the city and project partners could not agree on the terms. This creates even more uncertainty for potential future waste heat customers. They would be committing to a long-term contract without being able to predict how the network will develop. On the other hand, these customers are exactly what the network needs, an energy network is only viable if there is sufficient demand for it to pay off someday. But just the thought that the waste heat is being emitted and lost right next door every day is insane. Wondering: isn't it possible to find a compromise among all the stakeholders to take a step toward climate goals?

## WASTE HEAT USAGE


Waste heat represents a largely underutilised resource. In Switzerland, 35 % of available waste heat was recovered in 2019, leaving 65 % unused. Globally, the situation is more striking with only 3 % currently recovered, while 97 % going to waste.

Industrial processes and data centres generate considerable thermal energy that could be captured and reintegrated into heating systems. Waste heat recovery offers a practical approach to reducing primary energy demand and CO<sub>2</sub> emissions.

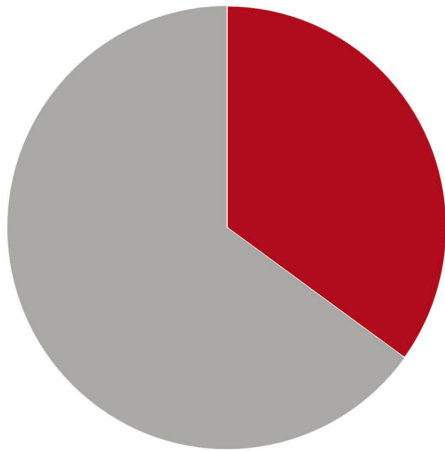

Waste Heat Utilisation in Switzerland in 2019.

- 35% used
- 65% unused

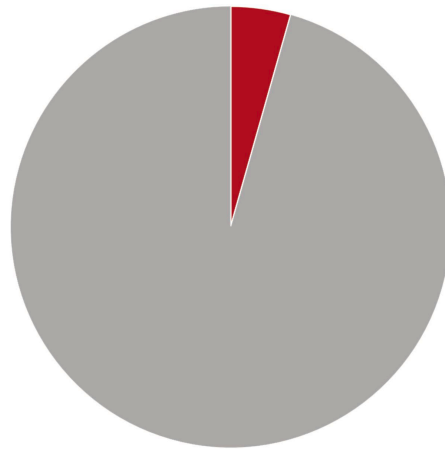




Waste Heat Utilisation globally in 2024.

- 3% used
- 97% unused


### WASTE HEAT UTILISATION: THREE CASE STUDIES

**ENERGY NETWORK ZÜRICH FRIESENBERG**




IT-Performance	Heating Demand FGZ	Heating Demand covered by Swisscom	Supplied Units (Homes)
4.8MW	35GWh/a	57.1%	2300

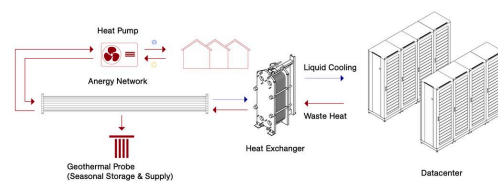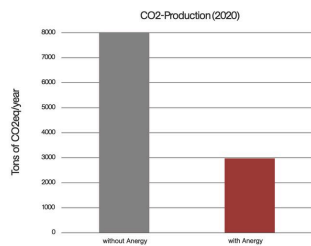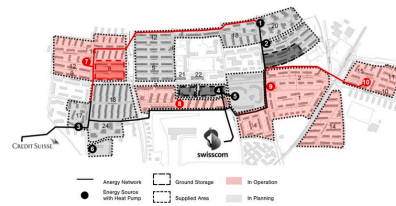

**BLOCKHEATING LIMBURG (NL)**






IT-Performance	Heating Demand Greenhouses	Heating Area	Supplied Greenhouses (1000m <sup>2</sup> )
200kW	1.3GWh/a	2ha	20 (summer) - 5 (winter)

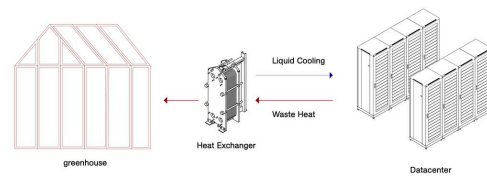

**FISHFARM DC2 TELEMAR (N)**




IT-Performance	Heating Demand Fishfarm	Heating Volume	Fishproduction
20MW	40GWh/a	750m <sup>3</sup>	9000t/year

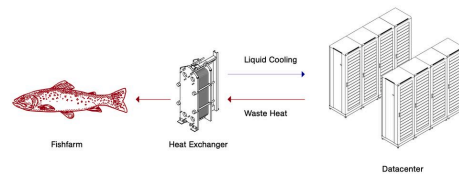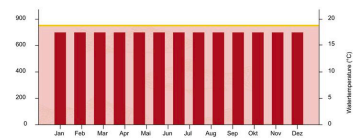

Waste heat from data centres can be utilised in diverse ways. The Swisscom facility in Zurich supplies over 2300 homes through an energy network, saving more than 3000 tons of CO<sub>2</sub> annually. In the Netherlands, a data centre heats commercial greenhouses, while a Norwegian facility maintains optimal temperatures for large-scale farming.

These examples demonstrate the versatility of waste heat recovery. From residential heating to agricultural and aquaculture applications. Each project significantly reduces CO<sub>2</sub> emissions while turning previously wasted energy into a valuable resource.

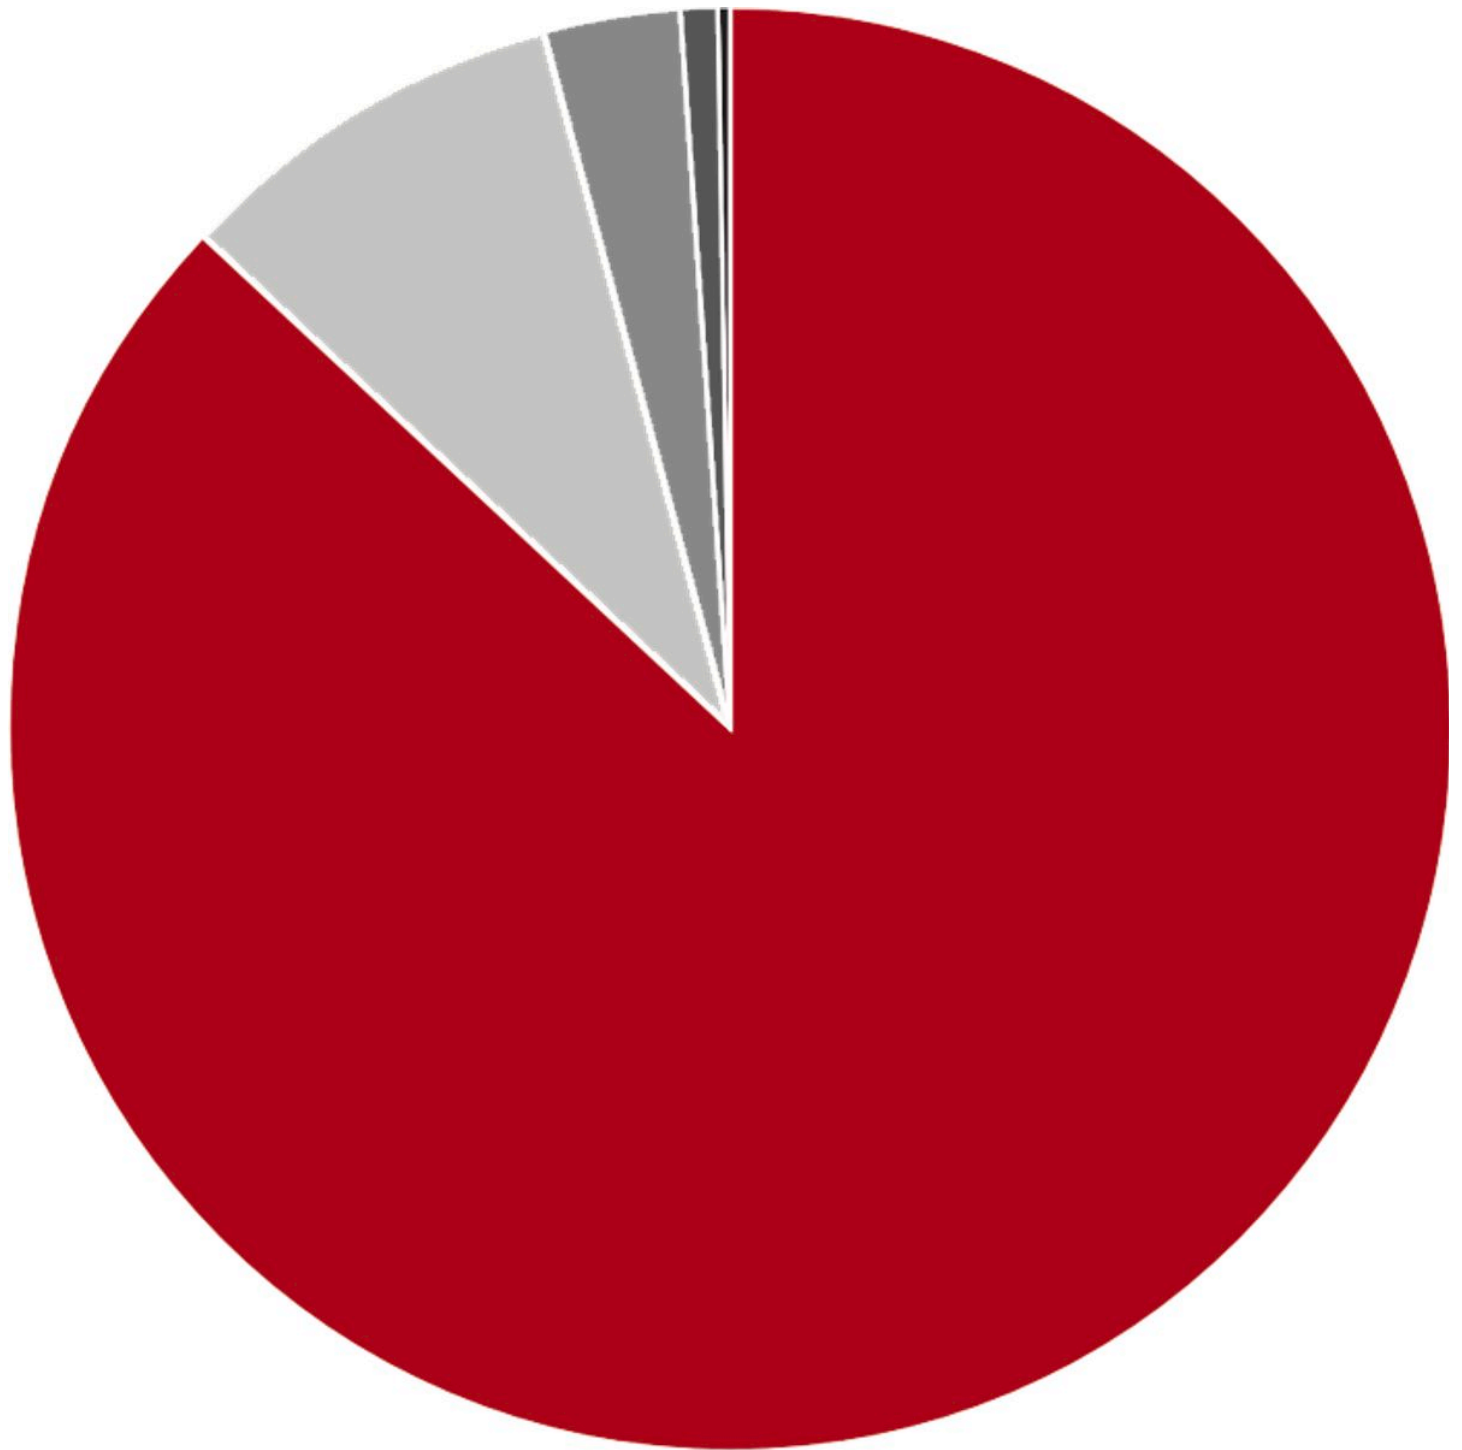

A 45 MW DATACENTER HAS A HEAT OUTPUT OF 51'694'500 WATT

0.01% people  
1% lighting


2.9% power distribution  
9% UPS with battery

87% IT-equipment

The magnitude of waste heat produced by a typical data centre is often underestimated. Consider a facility with a computational capacity of 45 megawatt (MW): the combined power of the three data centres of Digital Realty in Glattbrugg. Such a center generates approximately 51.5 MW of thermal energy as waste heat. If recovered with perfect efficiency, this output could supply the entire thermal energy demand (for residential and non-residential uses) in Zürich's Altstetten district. Alternatively, the same quantity of heat could operate 70 public swimming pools. Or if converted entirely to electrical energy, enable 18.8 InterCity train journeys from Zurich to Bern every hour. These comparisons illustrate not only the extraordinary energy density inherent in data centre operations, but also their potential for contributing positively to broader urban infrastructure.



WASTE HEAT COVERS THE THERMAL ENERGY DEMAND OF ALTSTETTEN (ZH)

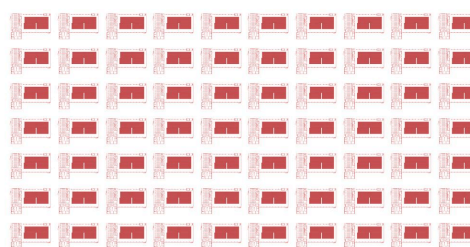


WASTE HEAT COVERS THE THERMAL ENERGY DEMAND OF 70 PUBLIC SWIMMING POOLS  
Source: Energie Schweiz, 2024.



WASTE HEAT COVERS THE ENERGY FOR 18.8 INTERCITY TRIPS ZURICH - BERN PER HOUR

## WASTE HEAT POTENTIAL

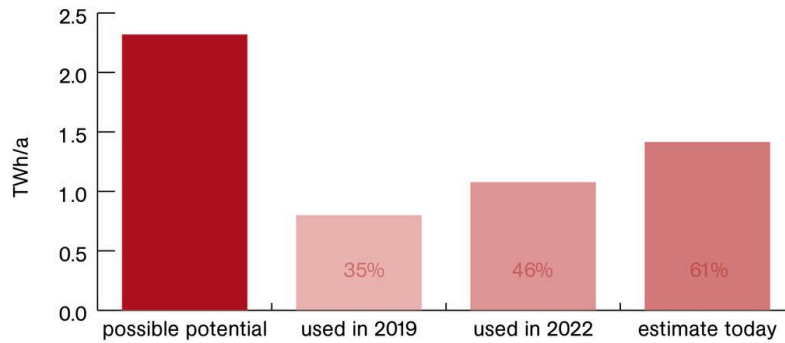


Waste heat potential of data centres in Switzerland. Source: EnergieSchweiz, 2023.

The realistic waste heat potential from data centers in Switzerland is between 2.02 and 2.62 terawatt hour per year (TWh/a) (median 2.32 TWh). In 2019, 35 % of data centres utilised this waste heat. By 2022, 46 % did, with another 15 % planning to do so. This gives a mid-term usage potential of 46–61 %. This waste heat could provide heating and hot water to 140,000–185,000 households (3.7–4.7 % of all Swiss homes), saving 420,000–555,000 tonnes of CO<sub>2</sub> per year by replacing fossil heating. Unlike other industries, data centres produce waste heat at a constant, reliable rate, year-round, 8,760 hours per year, making them secure sources for heating networks.

## ENERGY NETWORK AIRPORT CITY



Map of the perimeter of the Airport City energy network. Source: EBL, 2022.

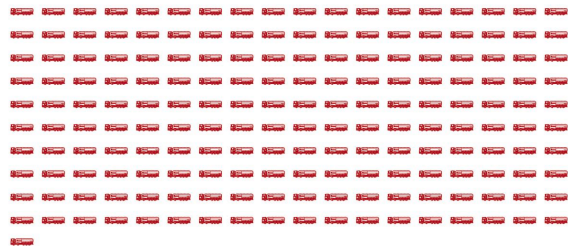

5.6 million liters of heating oil equal 181 large tank trucks with a capacity of approximately 31,000 liters each.

In projects like the Airport City Energy Network near Zurich Airport, operators aim to recycle the warmth produced by Digital Realty's facilities. Doing so could save 15,000 tons of CO<sub>2</sub> annually, the equivalent of 5.6 million liters of heating oil.


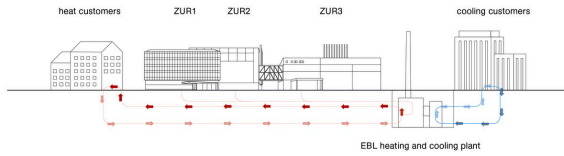


Diagram showing how the "Energieverbund" could work.

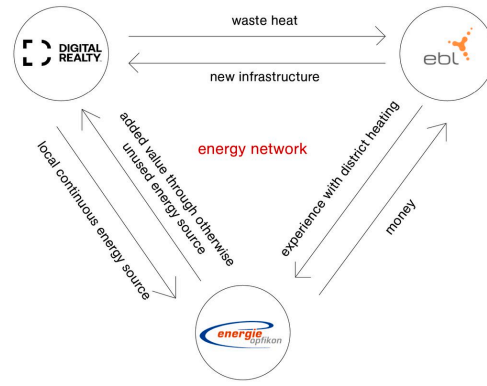

Players involved in planning the "Energieverbund" of the Airport City.

In a high-temperature waste heat network, the waste heat is usually extracted at a temperature level between 20°C and 30°C and then raised to the required level of 65°C–80°C using a heat pump. This allows even low-temperature waste heat from data centres to be used while still supplying areas that require higher temperatures (e.g., older buildings). The downside is higher investment costs and reduced energy efficiency due to the heat pump. After, it is distributed to customers through a network of pipes for heating, hot water production, or cooling. The goal is to use local energy more sustainably and reduce CO<sub>2</sub> emissions.

The three main players are DigitalRealty, which would supply the waste heat; EBL, which brings experience with district heating networks; and Energie Opfikon AG, responsible for providing the city with water and electricity.



The current energy sources of the buildings within the potential perimeter of the energy network.



The Airport City perimeter and its possible interested parties in waste heat and cold.



Potentially interested parties in heat and cold supply in the perimeter of the energy network and their current energy sources.

Compared to the current energy sources within the energy network, about 70 % comes from heating with oil and gas, which are fossil fuels that should be avoided whenever possible.


Looking at the map of potential waste heat recipients, it quickly becomes apparent that only a small number of buildings are affected; about one-third of the possible consumers within the energy network. This is even more surprising given that the potential waste heat from the data centres is actually much greater than the total heat demand of the entire network. Comparing these two maps, it becomes clear that primarily oil-fired boilers would be replaced, which would be a step toward renewable energy. However, looking at the grey areas, which show buildings not interested in connecting to the district heating network, there is a large amount of untapped potential. But why is this the case? Are there alternative energy sources that are more attractive? Or are the costs and associated risks too high?

The idea of an energy network has currently been put on hold because the city and project partners could not agree on the terms. This creates even more uncertainty for potential future waste heat customers. They would be committing to a long-term contract without being able to predict how the network will develop. On the other hand, these customers are exactly what the network needs, an energy network is only viable if there is sufficient demand for it to pay off someday. But just the thought that the waste heat is being emitted and lost right next door every day is insane. Wondering: isn't it possible to find a compromise among all the stakeholders to take a step toward climate goals?

## WASTE HEAT USAGE


Waste heat represents a largely underutilised resource. In Switzerland, 35 % of available waste heat was recovered in 2019, leaving 65 % unused. Globally, the situation is more striking with only 3 % currently recovered, while 97 % going to waste.

Industrial processes and data centres generate considerable thermal energy that could be captured and reintegrated into heating systems. Waste heat recovery offers a practical approach to reducing primary energy demand and CO<sub>2</sub> emissions.

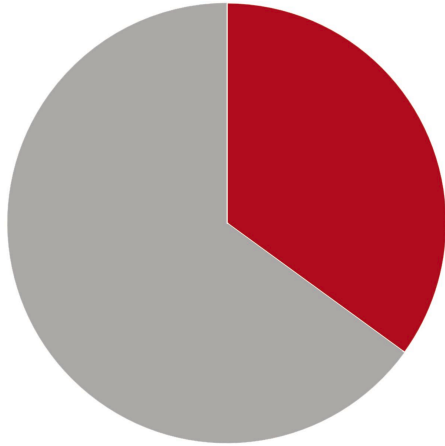

Waste Heat Utilisation in Switzerland in 2019.

- 35% used
- 65% unused

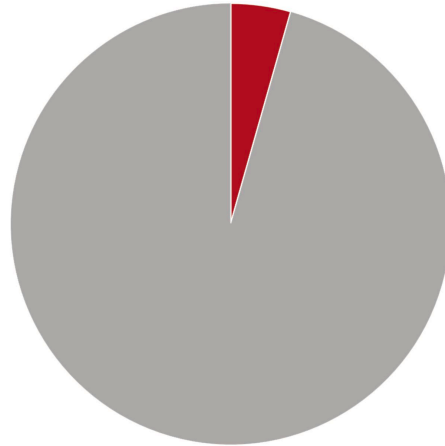




Waste Heat Utilisation globally in 2024.

- 3% used
- 97% unused


### WASTE HEAT UTILISATION: THREE CASE STUDIES

**ANERGY NETWORK ZÜRICH FRIESENBERG**




IT-Performance	Heating Demand FGZ	Heating Demand covered by Swisscom	Supplied Units (Homes)
4.8MW	35GWh/a	57.1%	2300

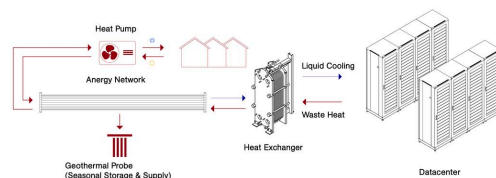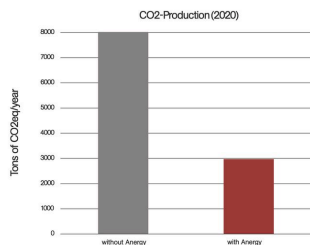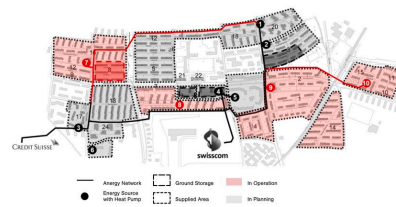

**BLOCKHEATING LIMBURG (NL)**






IT-Performance	Heating Demand Greenhouses	Heating Area	Supplied Greenhouses (1000m <sup>2</sup> )
200kW	1.3GWh/a	2ha	20 (summer) - 5 (winter)

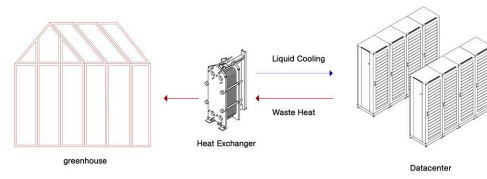

**FISHFARM DC2 TELEMAR (N)**



IT-Performance	Heating Demand Fishfarm	Heating Volume	Fishproduction
20MW	40GWh/a	750m <sup>3</sup>	9000t/year

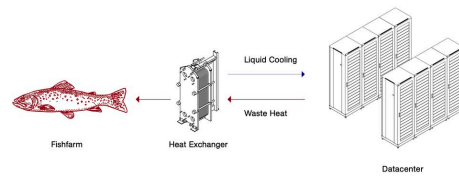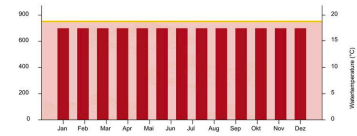


Waste heat from data centres can be utilised in diverse ways. The Swisscom facility in Zurich supplies over 2300 homes through an energy network, saving more than 3000 tons of CO<sub>2</sub> annually. In the Netherlands, a data centre heats commercial greenhouses, while a Norwegian facility maintains optimal temperatures for large-scale farming.


These examples demonstrate the versatility of waste heat recovery. From residential heating to agricultural and aquaculture applications. Each project significantly reduces CO<sub>2</sub> emissions while turning previously wasted energy into a valuable resource.

---

## From Fortress to Forum: Data Centres as Civic Infrastructure

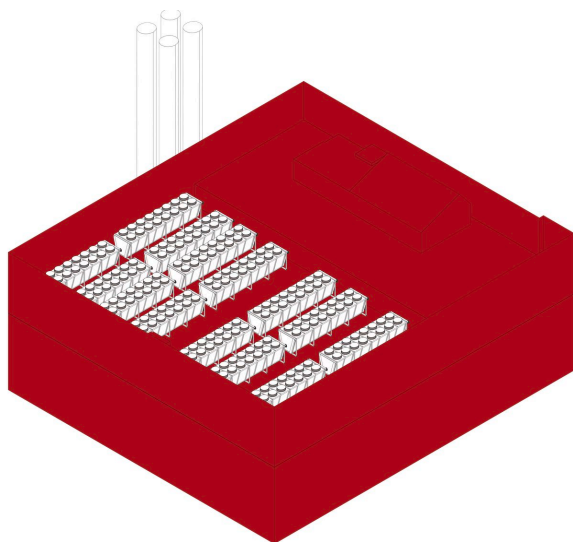

AXONOMETRY OF A TYPICAL DATA CENTRE

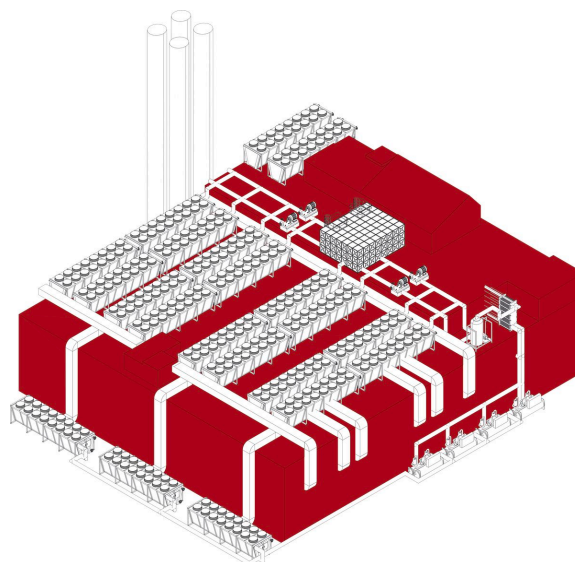


AXONOMETRY OF A DATA CENTRE WITH  
VISIBLE INFRASTRUCTURE (INSIDE OUT)  
Drawing: the authors, 2025.

Waste heat could become part of the urban metabolism, tying digital infrastructure into physical cities. Can data centres evolve into living, adaptive, or hybrid ecological systems? If computation was a public good, what would its architecture look like? Can visibility and design reclaim these buildings from anonymity and make the cloud a civic utility, not just a corporate fortress?




## CONCLUSIONS

When waste heat is left unused, it remains a private byproduct of corporate infrastructure. Communities miss out on tangible energy and climate benefits. Every unrecaptured watt means more fuel burned elsewhere, more emissions, and an invisible cost to the climate. But when cooling infrastructure becomes visible, acknowledged as part of our cities, it can spark awareness, innovation, and social pressure to use energy more intelligently.

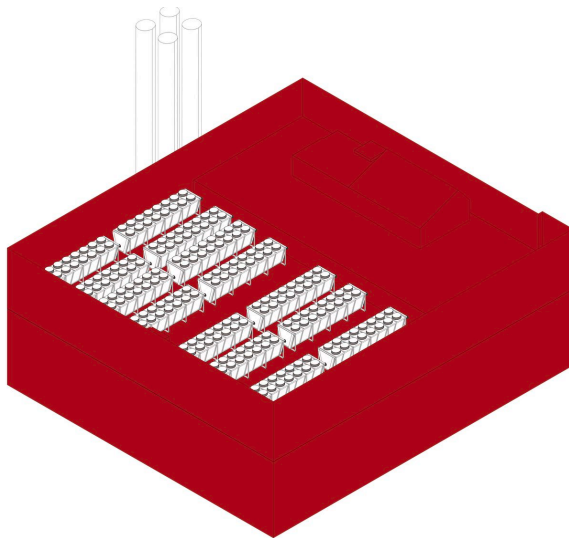

AXONOMETRY OF A TYPICAL DATA CENTRE

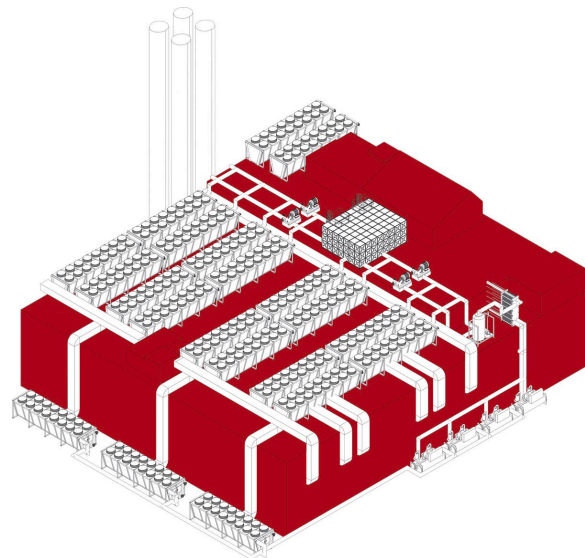

AXONOMETRY OF A DATA CENTRE WITH VISIBLE INFRASTRUCTURE (INSIDE OUT)

Drawing: the authors, 2025.

Waste heat could become part of the urban metabolism, tying digital infrastructure into physical cities. Can data centres evolve into living, adaptive, or hybrid ecological systems? If computation was a public good, what would its architecture look like? Can visibility and design reclaim these buildings from anonymity and make the cloud a civic utility, not just a corporate fortress?



## CONCLUSIONS

When waste heat is left unused, it remains a private byproduct of corporate infrastructure. Communities miss out on tangible energy and climate benefits. Every unrecaptured watt means more fuel burned elsewhere, more emissions, and an invisible cost to the climate. But when cooling infrastructure becomes visible, acknowledged as part of our cities, it can spark awareness, innovation, and social pressure to use energy more intelligently.

## SOURCES

- „Abwärmenutzung von Rechenzentren – Potenzialstudie und Empfehlungen für Betreiber und Gemeinden.“ Energie Schweiz. Accessed 28 October 2025. <https://pubdb.bfe.admin.ch/de/publication/download/1142>
- Alissa, H. et al. “Using life cycle assessment to drive innovation for sustainable cool clouds” Nature, 2025. Accessed 28 October 2025. <https://www.nature.com/articles/s41586-025-08832-3>
- Bundesamt für Energie. “Studie zur Stromeffizienz bei Rechenzentren in der Schweiz”. 2020. Accessed 20. October 2025. <https://www.bfe.admin.ch/bfe/de/home/suche.html#rechenzentren>
- Bytes2Heat. “Best Practices”. 2023. Accessed 20. October 2025. <https://www.bytes2heat.com/bestpractices>
- Digital Realty Switzerland, “ZUR3 is ready for hosting more customers.” *YouTube Video*, 1:37, posted by “Digital Realty Switzerland.” Accessed 28 October 2025. <https://www.youtube.com/watch?v=sgYuz3sjeCo>
- EnergieSchweiz. “Energiepotenziale Abwärme und erneuerbare Energien”. 2024. Accessed 20. October 2025. [https://www.local-energy.swiss/dam/jcr:7c94a709-04d2-48d8-a2f8-b1e2179f96a1/Raumliche\\_Energieplanung\\_M4\\_Energiepotenziale\\_de.pdf](https://www.local-energy.swiss/dam/jcr:7c94a709-04d2-48d8-a2f8-b1e2179f96a1/Raumliche_Energieplanung_M4_Energiepotenziale_de.pdf)
- Greenmountain. “DC2 Telemark Datacenter Fishfarm”. 2022. Accessed 20. October 2025. <https://greenmountain.no/green-mountain-dc2-telemark-expansion/>
- Horn, Sascha et al. “RZ-Wiki – Kälte- und Klimatechnik in Rechenzentrums-Infrastrukturen” Bitkom, 2025. Accessed 20. October 2025. <https://www.bitkom.org/sites/main/files/2025-05/bitkom-rz-wiki-kaelte-und-klimatechnik-in-rechenzentrums-infrastrukturen.pdf>
- „Luftbilder Glattbrugg.“ Karten der Schweiz – Schweizerische Eidgenossenschaft. Accessed 28 October 2025. <https://map.geo.admin.ch/#/map?lang=de&er=2684399\81,1254258\72&z=10\85&topic=ech&layers=ch.swisstopo.lubis-bildstreifen@year=2025,f;ch.swisstopo.swissboundaries3d-kanton-flaeche.fill&bgLayer=ch.swisstopo.swissimage&featureInfo=default&catalogNodes=457,458>
- Matthias Kolb. “Anergienetz Friesenberg”. Geothermie Forum Freiburg. 2021. Accessed 20. October 2025. [https://geothermie-schweiz.ch/wp\\_live/wp-content/uploads/2021/10/S3\2\\_04Anergienetz\\_Friesenberg\\_2109211-Lecture-seule.pdf](https://geothermie-schweiz.ch/wp_live/wp-content/uploads/2021/10/S3\2_04Anergienetz_Friesenberg_2109211-Lecture-seule.pdf)
- Microsoft. “Modern datacenter cooling”, 2023. Accessed 28. October 2025 [https://datacenters.microsoft.com/wp-content/uploads/2023/05/Azure\\_Modern-Datacenter-Cooling\\_Infographic.pdf](https://datacenters.microsoft.com/wp-content/uploads/2023/05/Azure_Modern-Datacenter-Cooling_Infographic.pdf)
- MWM. “Blockheating Container”. 2025. Accessed 20. October 2025. <https://www.mwm.net/blockheizkraftwerke/container-blockheizkraftwerk/>
- „Nachhaltige Abwärmenutzung: Fernwärme- und Kälteversorgung vom Energieverbund Airport City.“ Energieverbund Airport City. Accessed 28 October 2025. <https://www.energieverbund-airportcity.ch>
- „Perimeter Energieverbund.“ \*Energiegenossenschaft Baselland.\* Accessed 28 October 2025. [https://www.ebl.ch/hubfs/EBL/Landing%20Page%20Energieverbund%20Airport%20City/240320\\_Perimeter\\_Energieverbund%20Airport%20City.pdf](https://www.ebl.ch/hubfs/EBL/Landing%20Page%20Energieverbund%20Airport%20City/240320_Perimeter_Energieverbund%20Airport%20City.pdf)
- QGIS, “maps”, 2025 <https://qgis.org>
- Rasmussen, Neil. “Calculating Total Cooling Requirements for Data Centers” Schneider Electric, 2017. Accessed 20. October 2025 [https://www.se.com/us/en/download/document/SPD\\_NRAN-5TE6HE\\_EN/](https://www.se.com/us/en/download/document/SPD_NRAN-5TE6HE_EN/)
- „Rechenzentren.“ Kanton Zürich Baudirektion Amt für Abfall, Wasser, Energie und Luft. Accessed 28 October 2025. [https://www.zh.ch/content/dam/zhweb/bilder-dokumente/themen/planen-bauen/bauvorschriften/bauvorschriften-im-energiebereich/energetische-bauvorschriften/merkblaetter/2023\\_rechenzentren\\_v1.pdf](https://www.zh.ch/content/dam/zhweb/bilder-dokumente/themen/planen-bauen/bauvorschriften/bauvorschriften-im-energiebereich/energetische-bauvorschriften/merkblaetter/2023_rechenzentren_v1.pdf)
- Shiftlimburg. “Blockheating”. 2021. Accessed 20. October 2025. <https://shiftlimburg.nl/en/kennis-innovatie/blockheating-gives-servers-energy-second-life>
- Suter, Beat. „Fernwärme-Vertrag für Airport City platzt.“ \*Stadtanzeiger Opfikon\* online. 10 September 2025. <https://www.stadtanzeiger.ch/opfikon/artikel/fernwaerme-vertrag-fuer-airport-city-platzt>

This work by Serena Peier, Rebecca Grobotek, Matteo Bianchi, and Linus Ham was created as part of the design studio The Production of Cloud at ETH Zurich in Fall 2025. The PDF is intended for educational purposes only. Its commercial distribution is strictly forbidden.

© 2026, Architecture of Territory

Architecture of Territory  
Professor Milica Topalović

TEACHING TEAM

Martin Kohlberger  
Yiqiu Liu  
Jakob Walter  
Jan Westerheide

Prof. Milica Topalović  
ETH Zurich  
ONA G41  
Neunbrunnenstrasse 50  
8093 Zurich  
Switzerland  
+41 (0)44 633 86 88  
[www.topalovic.arch.ethz.ch](http://www.topalovic.arch.ethz.ch)